



Y04/YL4 INSTALLATION INSTRUCTIONS

Installation: The sounder or combined sounder strobe units can be affixed to most surfaces using the back box supplied separately.

Supply input: Ensure that the supply is correct for the voltage rating of the sounder or combined sounder strobe being installed. Ensure that the supply is OFF before making any connection and wire only in accordance with the terminal label detail.

Sound selection: Ensure the supply is OFF before proceeding. All dc and ac units have selectable alarm sounds (see table below for details) and are selectable by means of a 5 way dil switch SW1. A second sound is made available upon the application of a third wire connected to terminal TB1/3 as shown in Fig. 1 while still connected to terminal TB1/2. Alternatively 1st and 2nd stage sound signals can be generated by supply reversal (FOR DC UNITS ONLY) see Fig. 2. Independent second stage sound is available by using SW2 (OPTIONAL - only fitted with orders).

WARNING - Loud alarm sound. Wear ear defenders when testing, installing and commissioning.
- HIGH VOLTAGES ARE PRESENT WITHIN THE BEACON WHEN OPERATIONAL

SOUND SELECTION TABLE

<i>First Stage Sound</i>	<i>frequency</i>	<i>rept. rate</i>	<i>Second Stage</i>	<i>switches</i>	<i>Special Application</i>
	<i>Hertz</i>			<i>1 2 3 4 5</i>	
1 Alternate two-tone	800-1000	0.5	3	1 1 1 1 1	Fire Alarms
2 Alternate two-tone	2500-3100	0.5	4	0 1 1 1 1	Security Alarms
3 Alternate fast two-tone	800-1000	0.25	7	1 0 1 1 1	Increased urgency
4 Alternate fast two-tone	2500-3100	0.25	8	0 0 1 1 1	Security deterrent
5 Alternate two-tone	440-554	0.4/0.1	14	1 1 0 1 1	AFNOR, France
6 Alternate two-tone	430-470	1.0	14	0 1 0 1 1	
7 Alternate v.fast two-tone	800-1000	0.13	12	1 0 0 1 1	
8 Alternate v.fast two-tone	2500-3200	0.07	13	0 0 0 1 1	
9 Alternate two-tone	440-554	2.0	10	1 1 1 0 1	Turn-out, Sweden
10 Continuous note	700	-	1	0 1 1 0 1	All-clear, Sweden
11 Continuous note	1000	-	31	1 0 1 0 1	
12 Continuous note	1000	-	7	0 0 1 0 1	
13 Continuous note	2300	-	2	1 1 0 0 1	
14 Continuous note	440	-	9	0 1 0 0 1	
15 Interrupted tone	1000	2.0	31	1 0 0 0 1	
16 Interrupted tone	420	1.25	30	0 0 0 0 1	AS2220, Australia
17 Interrupted tone	1000	0.5	1	1 1 1 1 0	
18 Interrupted tone	2500	0.25	4	0 1 1 1 0	
19 Interrupted tone	2500	0.5	2	1 0 1 1 0	
20 Interrupted tone	700	6/12	10	0 0 1 1 0	Pre-vital mess, Sweden
21 Interrupted tone	1000	1.0	32	1 1 0 1 0	
22 Interrupted tone	700	4.0	10	0 1 0 1 0	Air-raid, Sweden
23 Interrupted tone	700	0.25	10	1 0 0 1 0	Local warning, Sweden
24 Interrupted tone	720	0.7/0.3	10	0 0 0 1 0	Industrial alarm, Germany
25 Int,fast,rising volume	1400	0.25	26	1 1 1 0 0	
26 Fast siren	250-1200	0.085	11	0 1 1 0 0	
27 Rising constant, fall	1000	10/40/10	17	1 0 1 0 0	Industrial alarm, Germany
28 ISO 8201 Evacuation	800-1000	as std	11	0 0 1 0 0	Int'l evacuation alarm
29 Fast whoop	500-1000	0.15	32	1 1 0 0 0	
30 Slow whoop	500-1200	4.5	12	0 1 0 0 0	Evacuation, The Netherlands
31 Reverse sweep	1200-500	1	11	1 0 0 0 0	Evacuation, Germany
32 Siren	500-1200	3.0	26	0 0 0 0 0	

CLIFFORD & SNELL, TOM CRIBB ROAD, THAMESMEAD LONDON SE28 0BH
TEL: 0208 317 1717 FAX: 0208 317 2400
web: cliffordandsnell.com
Email: cliffordandsnell@aol.com



switch settings: ON=1 and OFF=0

The PFEER sound signals recommended by UKOOA are:-

General Alarm	Sound Signal 15	Interrupted tone 1000 Hz
PAPA	Sound Signal 31	Reverse Sweep 1200-500 Hz
Toxic Gas	Sound Signal 11	Continuous Tone 1000 Hz.


MOUNTING: The Y04/YL4 series alarm units are supplied separate from the back box. The back box should be mounted to a suitable surface or to a standard wiring box using any of the mounting holes. 20mm cable entries are provided on all sides and in the base. To maintain the integrity of the weather seal, the cable entry must be via a suitable sealed gland.

D7210/5

CLIFFORD & SNELL, TOM CRIBB ROAD, THAMESMEAD LONDON SE28 0BH
TEL: 0208 317 1717 FAX: 0208 317 2400
web: cliffordandsnell.com
Email: cliffordandsnell@aol.com




FIGURE 1: DC INPUT - 2nd STAGE WITH THIRD WIRE

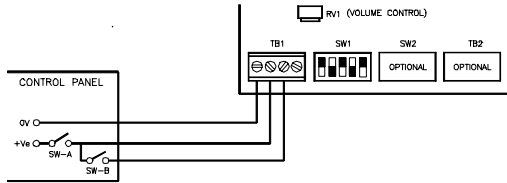

LINE INTEGRITY ON DC SYSTEMS
 - FOR 3 WIRE 2 STAGE ALARM SYSTEM,
 MONITOR VIA REVERSE POLARITY
 - FOR 2 WIRE 2 STAGE ALARM SYSTEM,
 MONITOR VIA THRESHOLD (APPLIED
 VOLTAGE < 1V)

FIGURE 2: DC INPUT - 2nd STAGE BY SUPPLY REVERSAL

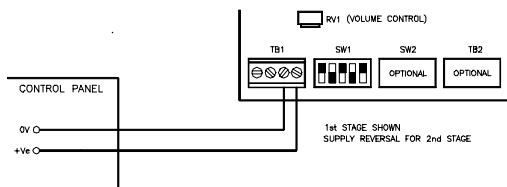

AN END-OF-LINE (E.O.L) RESISTOR IS
 REQUIRED FOR LINE MONITORING AND
 IT SHOULD BE A MINIMUM RESISTANCE
 OF 3K3 OHMS AND 0.5WATTS, WIRE-
 WOUND OR METAL FILM TYPE

FIGURE 3: AC INPUT


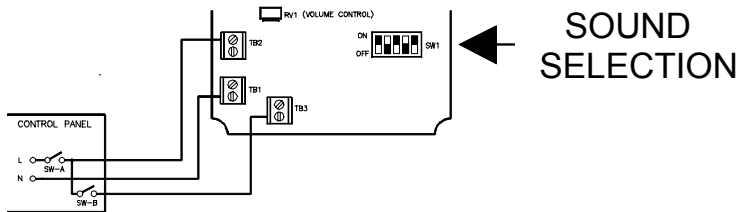


FIGURE 4: SYSTEM CONNECTION



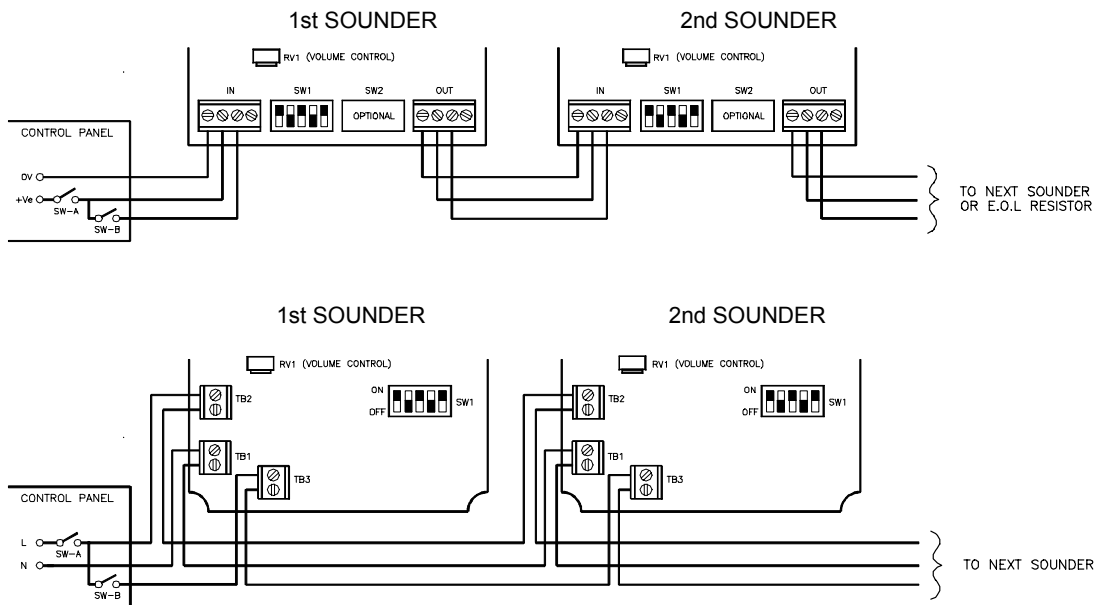

Note: The power supply for the Xenon Beacons (STROBES) is via the on-board terminal block:

For DC: Terminal (+) for +ve and Terminal (-) for 0v

For AC: Terminal (L) for LIVE and Terminal (N) for NEUTRAL.

CLIFFORD & SNELL, TOM CRIBB ROAD, THAMESMEAD LONDON SE28 0BH
TEL: 0208 317 1717 FAX: 0208 317 2400
web: cliffordandsnell.com
Email: cliffordandsnell@aol.com

X-ON Electronics

Largest Supplier of Electrical and Electronic Components

Click to view similar products for [Clifford And Snell](#) manufacturer:

Other Similar products are found below :

[YL50/L50/A/RF/WR](#) [YA80/D/RF/SU/WR](#) [YA40/D/RN/WR](#) [YA50/L/RF/WR](#) [YL40/N50/A/RN/WR](#) [YL40/D50/A/RN/WR](#)

[FD40/D00/A/RN/8](#) [FL40/N50/R/RN](#) [YL50/N50/R/RF/WR](#) [YA50/N/RF/WR](#) [YA50/D/RF/WR](#) [YL50/D50/R/RF/WR](#) [YA30/D/RF/WR](#)