

# SVR7 & SVR7M

## SAFETY ORGANIZATION(S) :

THIS FILTER HAS BEEN FORMALLY RECOGNIZED, CERTIFIED OR APPROVED BY THE LISTED AGENCY. THEREFORE, ALL TEST/REQUIREMENTS SPECIFIED IN THE LATEST REVISION OF THE FOLLOWING AGENCY STANDARDS HAVE BEEN MET.

UL RECOGNIZED  
CSA CERTIFIED  
VDE APPROVED

UL 1283  
CSA 22.2, NO.0,0.4,8  
VDE 565-3

## OPERATING SPECIFICATIONS:

LINE VOLTAGE/CURRENT: 5 AMP, 120/250 VACD  
5 AMP./40°C, 250 VAC

LINE FREQUENCY, 50-60Hz

MAX. LEAKAGE CURRENT, EACH: .5 mA AT 120V 60Hz  
LINE TO GROUND, .83 mA at 250V 50Hz

OPERATING AMBIENT TEMP. RANGE, -10°C TO +40°C @ RATED CURRENT,  $I_r$

IN AN AMBIENT,  $T_a$ , HIGHER THAN 40°C, THE MAXIMUM OPERATING CURRENT,  $I_o$ , IS AS FOLLOWS:

$$I_o = I_r \sqrt{\frac{85 - T_a}{45}}$$

## RELIABILITY SPECIFICATIONS:

STORAGE TEMPERATURE, -40°C TO +85°C  
HUMIDITY, 21 DAYS @ 40°C 95% RH  
CURRENT OVERLOAD TEST, 6 TIMES RATED CURRENT FOR 8 SECONDS

## TEST SPECIFICATIONS:

INDUCTANCE, 1.032 mH NOMINAL  
CAPACITANCE, (MEASURED @ 1 KHz, 0.25VAC MAX., 25°C±1°C)  
LINE TO GROUND, .011 μF ±20%  
LINE TO LINE, .303 μF ±20%  
DISCHARGE RESISTOR, 680KΩ


LINE/GROUND AND LINE/LINE, 6000MΩ (MIN) AT 100VDC  
INSULATION RESISTANCE, 20°C AND 50% RH

## RECOMMENDED RECEIVING INSPECTION HIPOT:

LINES TO GROUND, 2250 VDC FOR 1 MINUTE  
LINE TO LINE, 1450 VDC FOR 1 MINUTE

## FILTER APPROVAL:

THE BEST WAY TO SELECT AND QUALIFY A FILTER IS FOR YOUR ENGINEERING TO TEST THE UNIT IN YOUR EQUIPMENT.

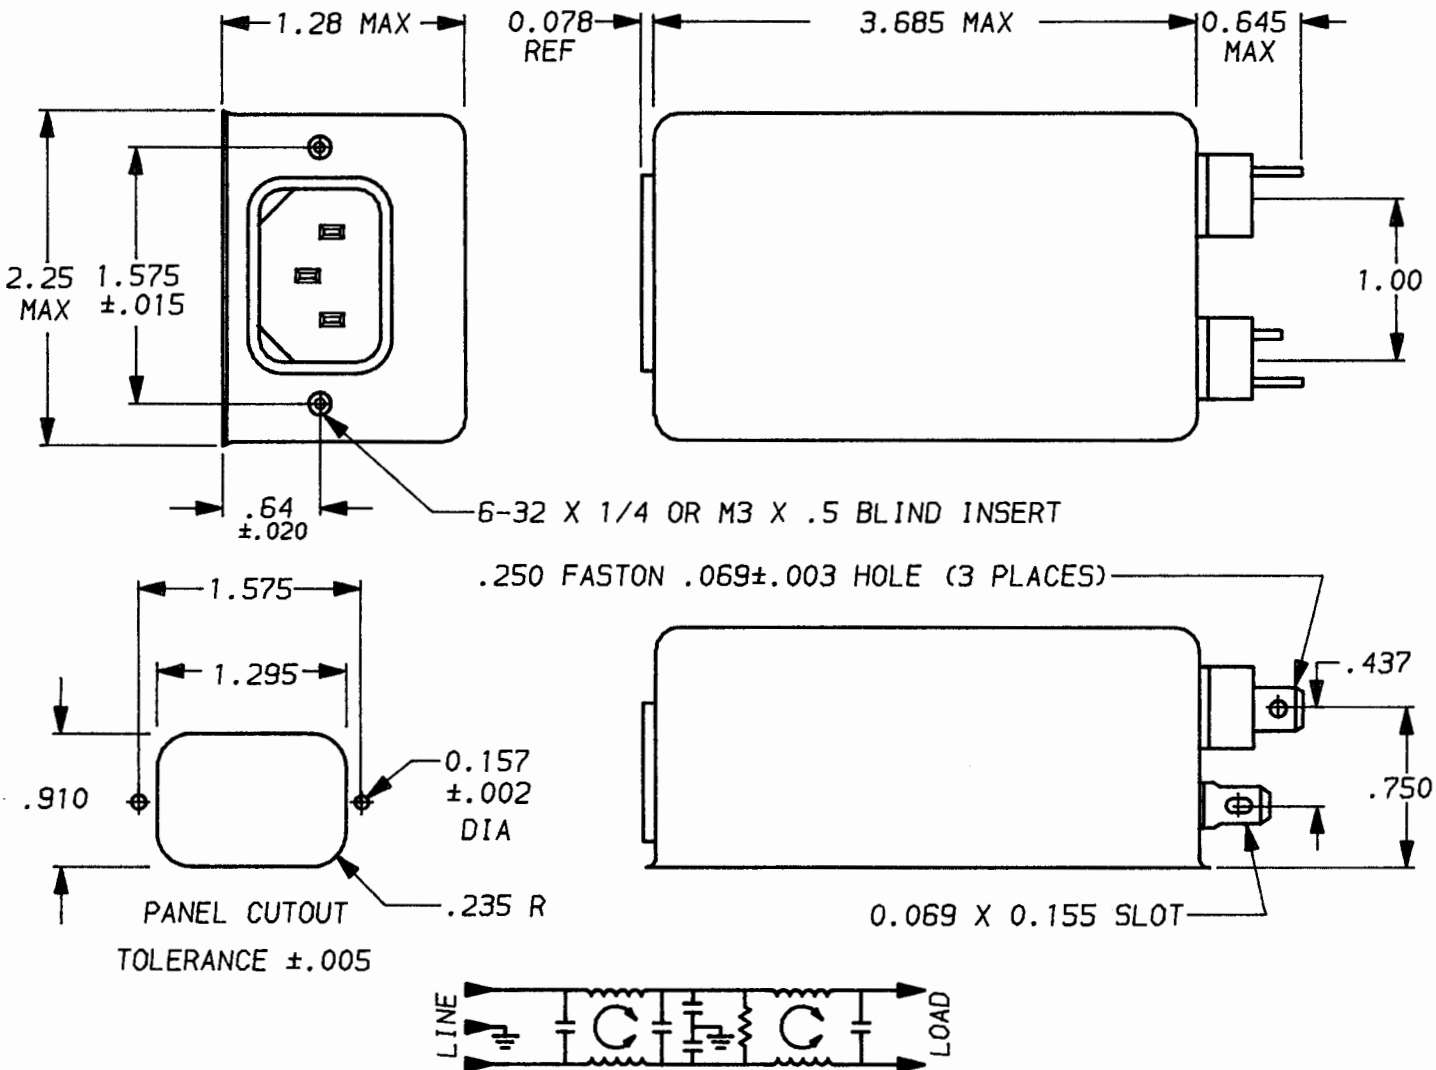

50Ω - 50Ω (MINIMUM) INSERTION LOSS											
FREQUENCY MHz	.15	.3	.5	1	2	5	10	20	30	/	/
COMMON dB	5	27	44	60	65	65	65	65	65	/	/
DIFF. dB	3	3	10	60	65	65	65	65	65	/	/

UNLESS OTHERWISE SPECIFIED, TOLERANCE TO BE ±.025  
MATERIAL & FINISH, AS SUPPLIED  
This document is proprietary to CORCOM INC. and is not to be reproduced nor used for manufacturing purposes except on CORCOM'S prior written consent.

**corcom**  
LIBERTYVILLE, IL 60048

**POWER LINE FILTER**

DATE: 9-23-93 CATALOG NO.  
APPRVD: TAWM SVR7 & SVR7M  
CAD NO. SVR7.08