




REV
B DT04-12PA-LE06

REVISIONS			
SYM	DESCRIPTION	DATE	APPROVED
NC	NEW RELEASE PER E.O. A14567	3/14/94	J.A.
A	REVISED PER E.O. P21099	9/23/11	R.D.R.
B	REVISED PER E.O. P21406	7-6-12	RDR

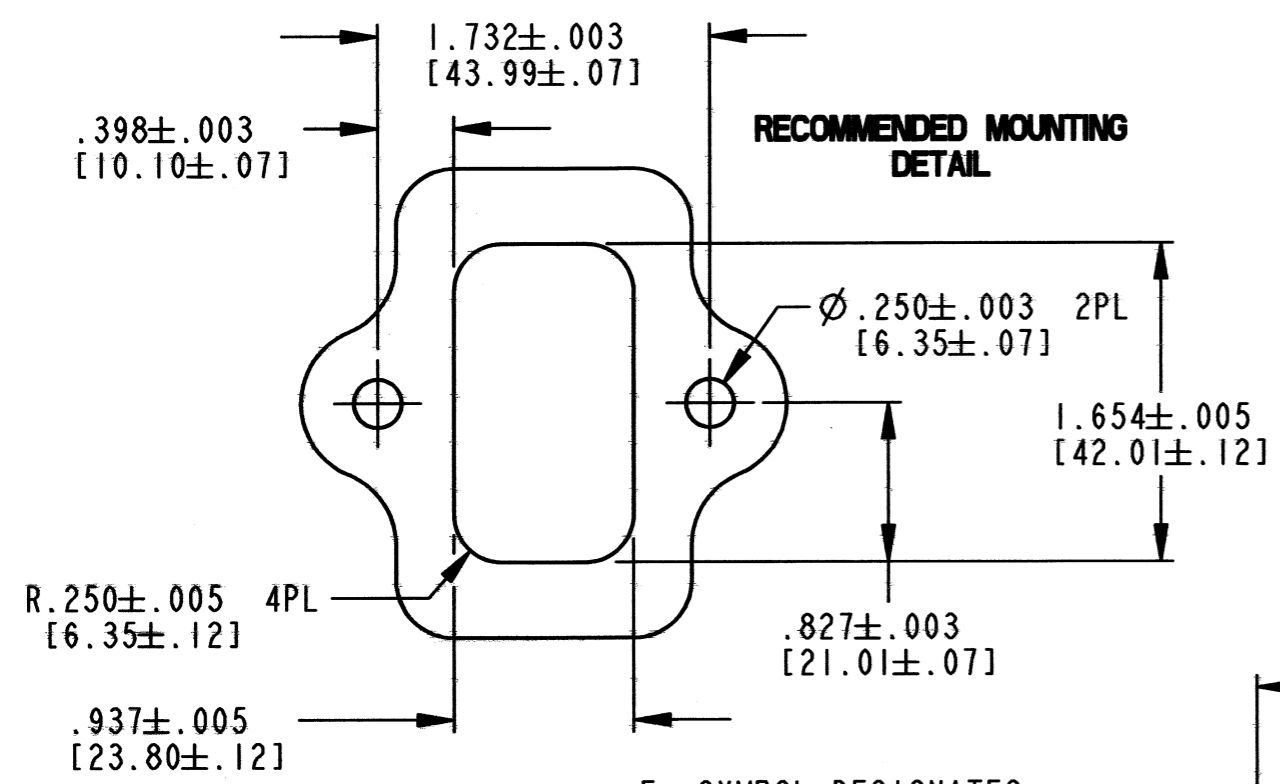


RECOMMENDED MOUNTING
DETAIL

CONTACT SIZE	MIN. INSUL. O.D.	MAX. INSUL. O.D.	WIRE RANGE REF ONLY
16	.053 [1.35]	.120 [3.05]	14-20 AWG [2.0-0.5]

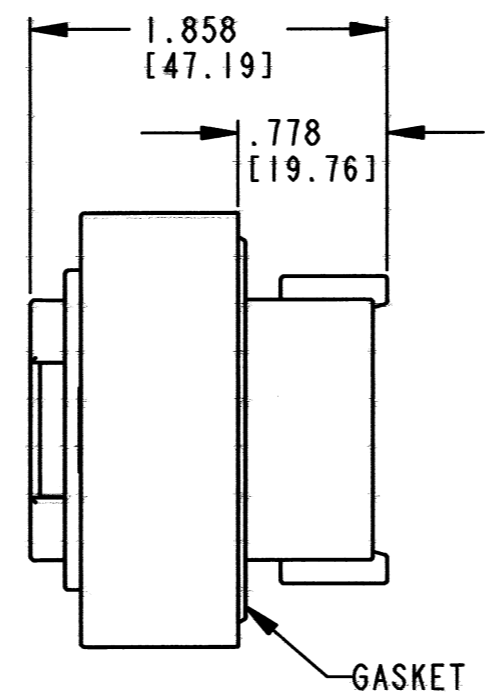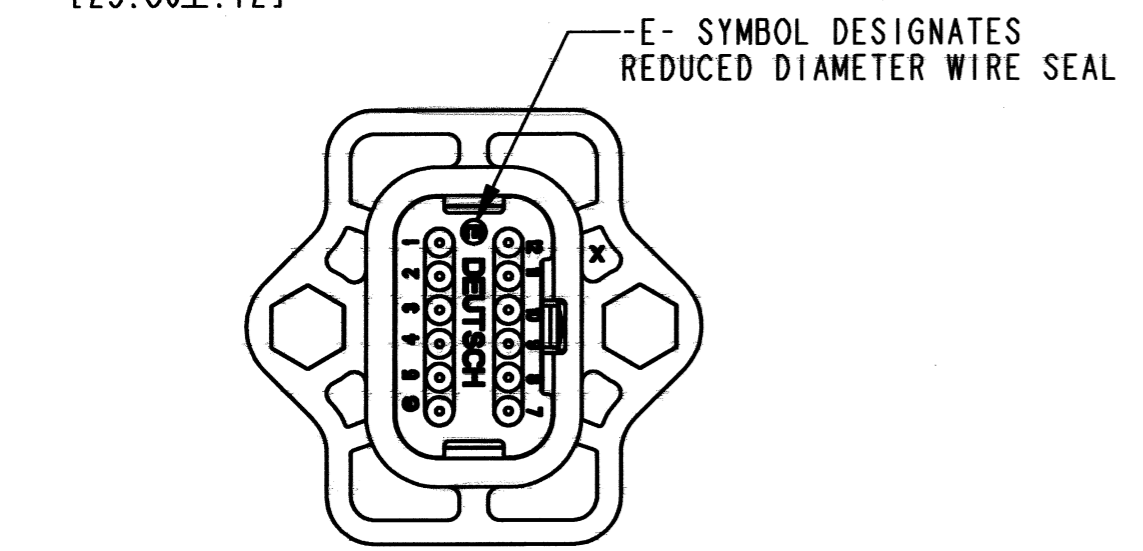

THREADED INSERT
M6 X .500 DEEP
RECOMMENDED TORQUE:
62-88 IN-LB [7-10 N-m]
2 PLACES

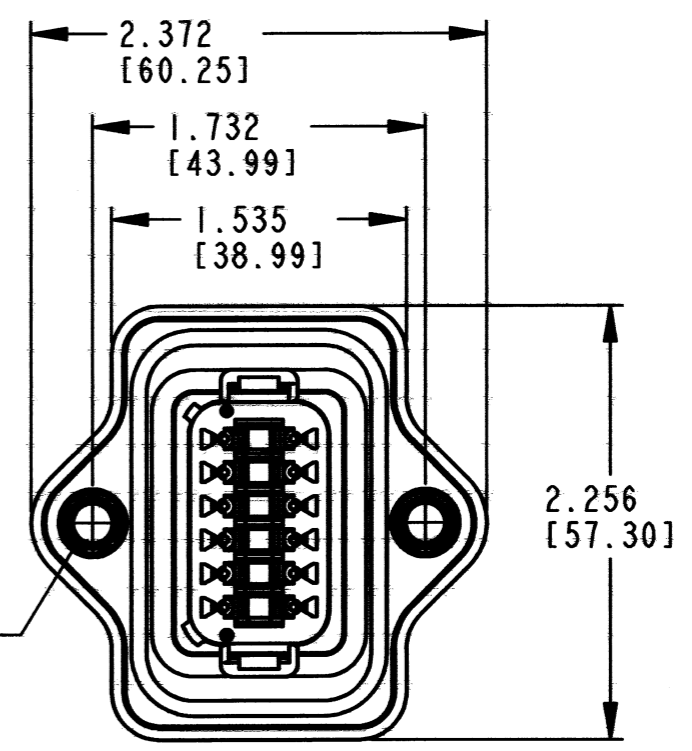

- NOTES:
- DIMENSIONS ARE IN INCHES [MILLIMETER].
 - DIMENSIONS ARE ±.025 [0.64] UNLESS OTHERWISE SPECIFIED.
 - FOR CONTACTS AND WIRE PERFORMANCE AND APPLICATION CHARACTERSTICS, SEE ENVELOPE DRAWINGS 0425-015-0000 AND 0425-017-0000.
 - THIS RECEPTACLE MATES WITH DT06-12SA-**** PLUG. (**** = ALL MODIFICATIONS) CONSULT FACTORY FOR MODIFICATIONS.
 - MATERIAL: SHELL: PLASTIC; SEAL & GASKET: RUBBER; INSERT: STAINLESS STEEL.

SIGNATURE & DATE	
DR	C. WOODRUFF 14MAR94
CHK	<i>[Signature]</i> 7/6/2012
PE	<i>[Signature]</i> 7/5/12
APPD	<i>[Signature]</i> 7/5/12
SCALE	NONE WT

12 WAY RECEPTACLE
FLANGE MOUNT
THIN WALL WIRE SEAL
COLOR: GRAY
D.T. SERIES

ENVELOPE

EP	MATL. CODE
3850 INDUSTRIAL AVE. HEMET, CA 92545	
B	DT04-12PA-LE06
DWG SIZE	CODE 11139 SHEET OF