Monitoring Relays 1-Phase True RMS AC/DC Over and Under Voltage Types DUC01, PUC01

TRMS AC/DC over+under, over+over or under+under voltage monitoring relays Selection of measuring range by DIP su

- Selection of measuring range by DIP-switches
- Measuring ranges from 2 to 500 V AC/DC
- Adjustable voltage on relative scale
- Adjustable hysteresis on relative scale
- Adjustable delay function (0.1 to 30 s)
- Programmable latching or inhibit at set level
- Output: 1 or 2 x 8 A SPDT relay N.D. or N.E. selectable
 For mounting on DIN-rail in accordance with DIN/EN 50 022 (DUC01) or plug-in module (PUC01)
- 45 mm Euronorm housing (DUC01)
 45 mm Euronorm housing (DUC01)
- or 36 mm plug-in module (PUC01)

 LED indication for relay, alarm and power supply ON
- Galvanically separated power supply

Product Description

DUC01

DUC01 and PUC01 are precise TRMS AC/DC over+under, over+over or under+under voltage (selectable by DIP-switch) monitoring relays. The voltage levels are adjustable separately and have their own time delay. Owing to the built-in latch function, the ON-position of the relay output can be maintained. Inhibit function can be used to avoid relay operation when not desired (maintenance, transitions). The LED's indicate the state of the alarm and the output relay.

PUC01

Output

2xSPDT

SPDT

Ordering Key DUC 01 D B23 500V

Housing Function Type		
Item number —		
Output	_	
Power supply		
Bange		

Type Selection

Mounting DIN-rail Plug-in

Input Specifications

Input (voltage level) DUC01 PUC01	Terminals Y1, Y2 Terminals 5, 7	
Measuring ranges		
Direct	Internal resist.	Max. volt.
Selectable by DIP-switch		
2 to 20 V AC/DC	> 500 kΩ	350 V
5 to 50 V AC/DC	> 500 kΩ	350 V
20 to 200 V AC/DC	> 500 kΩ	600 V
50 to 500 V AC/DC	> 500 kΩ	600 V
Max. voltage for 1 s		1000 V
Note: The input voltage cannot raise over 300 VAC/DC with respect to ground (PUC01 only)		
Contact input DUC01 PUC01 Disabled Enabled Latch disable	Terminals Z1, Y Terminals 8, 9 $> 10 \text{ k}\Omega$ $< 500 \Omega$ > 500 ms	1

Output Specifications

Supply: 24 to 48 VAC/DC

DUC 01 D D48 500V

PUC 01 C D48 500V

Output	2 x SPDT relays (DUC01) 1 x SPDT relays (PUC01)
Rated insulation voltage	250 VAC
Contact ratings (AgSnO ₂)	
Resistive loads AC 1 DC 12	8 A @ 250 VAC 5 A @ 24 VDC
Small inductive loads AC 15 DC 13	2.5 A @ 250 VAC 2.5 A @ 24 VDC
Mechanical life	\geq 30 x 10 ⁶ operations
Electrical life	\geq 10 ⁵ operations (at 8 A, 250 V, cos ϕ = 1)
Operating frequency	\leq 7200 operations/h
Dielectric strength Dielectric voltage Rated impulse withstand volt.	≥ 2 kVAC (rms) 4 kV (1.2/50 μs)

CARLO GAVAZZI

Supply: 115/230 VAC

DUC 01 D B23 500V

PUC 01 C B23 500V



Supply Specifications

Power supply Rated operational voltage through terminals: A1, A2 or A3, A2 (DUC01) 2, 10 or 11, 10 (PUC01)	Overvoltage cat. III (IEC 60664, IEC 60038)	
D48:	24 to 48 VAC ± 15%	
	45 to 65 Hz, insulated	
B23:	115/230 VAC ± 15%	
	45 to 65 Hz, insulated	
Dielectric voltage	DC supply AC supply	
Supply to input	2 kV 4 kV	
Supply to output	4 kV 4 kV	
Input to output	4 kV 4 kV	
Rated operational power		
AC .	5 VA	
DC	3 W	

General Specifications

Power ON delay	1 s \pm 0.5 s or 6 s \pm 0.5 s	
Reaction time	(input signal variation from -20% to +20% or from +20% to -20% of set value)	
Alarm ON delay	< 100 ms	
Alarm OFF delay	< 100 ms	
Accuracy	(15 min warm-up time)	
Temperature drift	\pm 1000 ppm/°C	
Delay ON alarm	\pm 10% on set value \pm 50 ms	
Repeatability	\pm 0.5% on full-scale	

General Specifications (cont.)			
Indication for	NI		
Power supply O	IN .	LED, green	
Alarm ON		LED, red (flashing 2 Hz during delay time)	
Output relay ON		1 or 2 x LED, yellow	
Environment		(EN 60529)	
Degree of protect	ction	IP 20	
Pollution degree		3 (DUC01), 2 (PUC01)	
Operating tempe	erature	-20 to 60°C, R.H. < 95%	
Storage tempera	ature	-30 to 80°C, R.H. < 95%	
Housing			
Dimensions	DUC01	45 x 80 x 99.5 mm	
	PUC01	36 x 80 x 94 mm	
Material		PA66 or Noryl	
Weight		Approx. 250 g	
Screw terminals			
Tightening torqu	e	Max. 0.5 Nm	
		acc. to IEC 60947	
Product standar	d	EN 60255-6	
Approvals		UL, CSA	
CE Marking		L.V. Directive 2006/95/EC	
		EMC Directive 2004/108/EC	
EMC			
Immunity		According to EN 60255-26	
		According to EN 61000-6-2	
Emissions		According to EN 60255-26	
		According to EN 61000-6-3	

General Specifications (cont.)

Mode of Operation

DUC01 and PUC01 monitor both AC and DC over+under, over+over or under+under voltage.

Example 1

(no contact input under+over voltage - 2 x SPDT relays (1 x SPDT for PUC01))

DUC01: One relay operates when the voltage drops below the under voltage set point for more than the respective delay time. It releases when the voltage exceeds the set level plus the set hysteresis. The other relay operates when the voltage exceeds the over voltage set point for more than the respective delay time. It releases when the voltage drops below the set level minus hysteresis (the hysteresis is the same for both set levels).

PUC01: The relay operates when the voltage drops below the under voltage set level for more than the respective set delay time or when it exceeds the over voltage set level for more than the respective set delay time. The relay releases when the voltage exceeds the under voltage set level plus hysteresis and it drops below the over voltage set level minus hysteresis (the hysteresis is the same for both set levels).

Example 2

(latch enabled active under+ under voltage - 2 x SPDT relays (1 x SPDT for PUC01))

DUC01: Each relay operates

Example 3

and latches when the volt-

age drops below the respec-

tive set level for more than

the respective delay time. Provided that the voltage

has exceeded the respective

set level (see hysteresis),

each relay releases when the

contact input's connection is

PUC01: The relay operates

when the voltage drops

below the higher set level for

more than the respective

delay time. Provided that the

voltage has exceeded the

respective set level plus hys-

teresis, the relay releases

when the contact input is

interrupted.

opened.

(inhibit enable active - over+ over voltage - DPDT relay (1 x SPDT for PUC01))


Provided that the contact input is opened, the relay operates when the voltage exceeds the lower set level for more than the respective delay time. It releases when the voltage drops below the lower set level (see hysteresis) or when the contact input's pins are connected.

Note:

When the inhibit contact is opened, if the input signal is already in alarm position, the delay time needs to elapse before relay(s) activation.




Function/Range/Level and Time Delay Setting

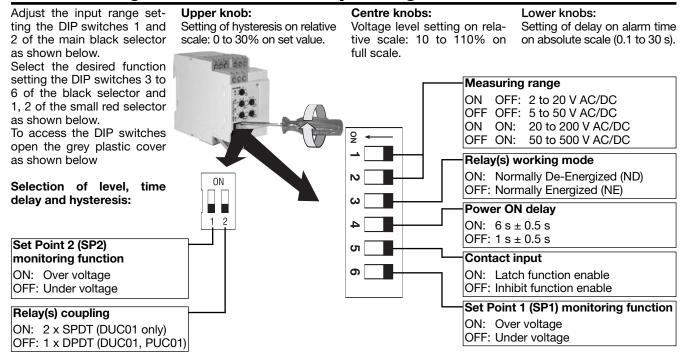


Operation Diagrams

Over+over voltage - N.D. relay(s)

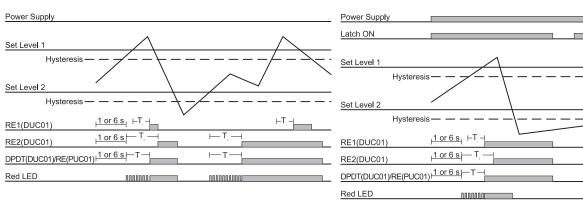


Over+under voltage - N.D. relay(s)

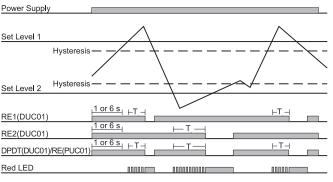

Over+under voltage - Latch - N.D. relay(s)

Over+over voltage - Latch - N.D. relay(s)

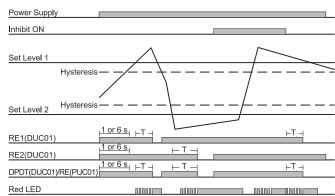

⊢T


 $\vdash T$

......




Operation Diagrams (cont.)




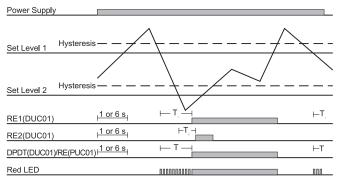

Wiring Diagrams

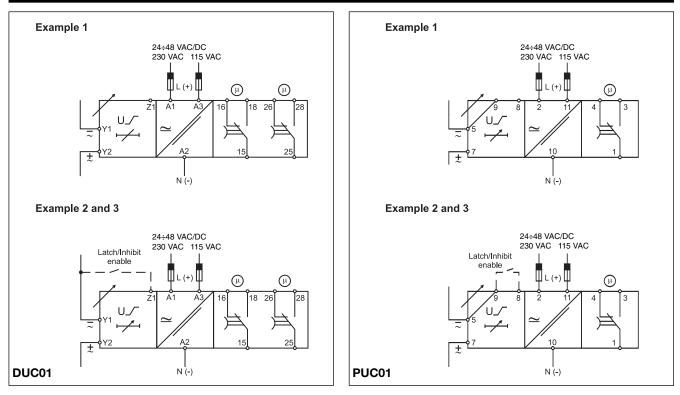

Dimensions

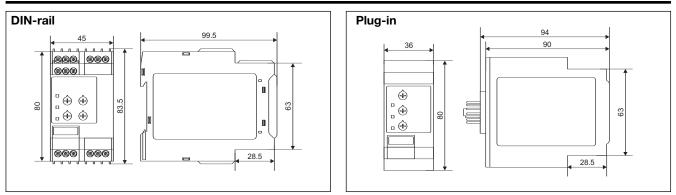

X-ON Electronics

Largest Supplier of Electrical and Electronic Components

Click to view similar products for Industrial Relays category:

Click to view products by Carlo Gavazzi manufacturer:

Other Similar products are found below :

 6-1617801-8
 6-1618107-9
 7-1618273-3
 EV250-4A-02
 EV250-6A-01
 FCA-125-CX8
 FCA-325-159
 FCA-410-138
 8000-S3121
 8-1618273-6

 8-1618393-1
 GCA63A220VAC60HZ
 GCA63A277VAC60HZ
 GCA63A600VAC60HZ
 1-1672275-3
 1-1833005-4
 H-16/S1
 A711Z

 ACC530U20
 ACC633U30
 ACC730U30
 DH18DA
 1423675-8
 AVR907
 15732A200
 B07B032AC1-0329
 B329
 B490A
 1618279-1

 BHR124Y
 1810DDB-SX
 N417
 P30C42A12D1-120
 2-1617748-6
 2-1618396-6
 2-1618398-1
 JMGACD-5M
 JMGSC-5LW
 JMGSCD-5L

 PBO-18A1218
 PBO-40A3040
 K8DSPH1200480VAC
 KA-3C-12A
 RT334012WG
 S160156115
 SAH159
 2944795
 301-17SX
 1618105-2

 1618112-6

 S160156115
 SAH159
 2944795
 301-17SX
 1618105-2