Energy Management **Smart Modular Power Analyzer Type WM30 96**





- One RS232 and RS485 port (on request)
- Communication protocol: MODBUS-RTU
- MODBUS TCP/IP Ethernet port (on request)
- BACnet-IP over Ethernet port (on request)
- BACnet MS/TP over RS485, BTL approved (on request)
- Ethernet/IP port, ODVA approved (on request)
- Profibus DP V0 port (on request)
- Up to 2 digital outputs (pulse, alarm, remote control) (on request)
- Up to 4 freely configurable virtual alarms
- Up to 2 analogue outputs (+20mA, +10VDC) (on request)


Product Description

Three-phase smart recommended for measurement of the with digital outputs that can be WM3040Soft.

power either for pulse proportional to the analyzer with built-in advanced active and reactive energy being configuration system and LCD measured or/and for alarm outputs. data displaying. Particularly The instrument can be equipped the with the following modules: RS485/ main RS232, Ethernet, BACnet-IP, electrical variables. WM30 is BACnet MS/TP or Profibus DP based on a modular housing for V0 communication ports, pulse panel mounting with IP65 (front) and alarm outputs. Parameters protection degree. Moreover, programming and data reading can the analyzer can be provided be easily performed by means of

- · Class 0.5S (kWh) according to EN62053-22
- Class C (kWh) according to EN50470-3
- Class 2 (kvarh) according to EN62053-23
- Accuracy ±0.2% RDG (current/voltage)
- Instantaneous variables readout: 4x4 DGT
- Energies readout: 9+1 DGT
- System variables: VLL, VLN, A, VA, W, var, PF, Hz, Phase-sequence-asymmetry-loss.
- Single phase variables: VLL, VLN, AL, An (calculated), VA, W, var, PF
- · Both system and single phase variables with average and max calculation
- Harmonic analysis (FFT) up to the 32nd harmonic (current and voltage)
- · Energy measurements (imported/exported): total and partial kWh and kvarh
- Energy measurements according to ANSI C12.20 CA 0.5, ANSI C12.1 (revenue grade)
- Run hours counter (8+2 DGT)
- Real time clock function
- Application adaptable display and programming procedure (Easyprog function)
- Universal power supply: 24-48 VDC/AC, 100-240 VDC/AC
- Front dimensions: 96x96 mm
- Front protection degree: IP65, NEMA4X, NEMA12

How to order WM30-96 AV5 3 H R2 A2 S1 XX



Type Selection

Range	e codes	Syst	em	Powe	er supply	A Ou	tputs
AV4:	400/690V _{LL} AC 1(2)A V _{LN} : 160V to 480V _{LN}	3:	balanced and unbalanced load: 3-phase, 4-wire;	H:	100-240 +/-10% (90 to 255) VDC/AC (50/60 Hz)	XX: 02:	none Dual channel static output
AV5:	V _{LL} : 277V to 830V _{LL} 400/690V _{LL} AC 5(6)A V _{LN} : 160V to 480V _{LN}		3-phase, 3-wire; 2-phase, 3-wire; 1-phase, 2-wire	L:	24-48 +/-15% (20 to 55) VDC/AC (50/60 Hz)	R2:	Dual channel relay output
AV6:	V _{LL} : 277V to 830V _{LL} 100/208V _{LL} AC	Optio	ons	Com	munication	B Ou	tputs
AV7:	5(6)A V _{LN} : 40V to 144V _{LN} V _{LL} : 70V to 250V _{LL} 100/208V _{LL} AC	XX :	none	XX: S1: E2:	none RS485/RS232 port Ethernet / Internet	XX: A2:	none Dual channel 20mA DC output
	1(2)A V _{LN} : 40V to 144V _{LN} V _{L1} : 70V to 250V _{L1}			B1:	port BACnet (IP) over Ethernet	V2:	Dual channel 10V DC output
				B3:	BACnet (MS/TP) over RS485		
				E6:	Ethernet/IP port		

P1:

Profibus DP/V0 port




Position of modules and combination

Ref	Description	Main features	Part number	Pos. A	Pos. B	Pos. C
1		Inputs/system: AV5.3Power supply: H	WM30 AV5 3 H			
2		Inputs/system: AV6.3Power supply: H	WM30 AV6 3 H			
3		Inputs/system: AV4.3Power supply: H	WM30 AV4 3 H			
4	WM30 base provided with display,	Inputs/system: AV7.3Power supply: H	WM30 AV7 3 H			
	power supply, measuring inputs	Inputs/system: AV5.3Power supply: L	WM30 AV5 3 L			
		Inputs/system: AV6.3Power supply: L	WM30 AV6 3 L			
		Inputs/system: AV4.3Power supply: L	WM30 AV4 3 L			
		Inputs/system: AV7.3Power supply: L	WM30 AV7 3 L			
5	Dual relay output (SPDT)	 2-channel Alarm or/and pulse output	M O R2	Х		
6	Dual static output (AC/DC Opto-Mos)	 2-channel Alarm or/and pulse output	M O O2	х		
7	Dual analogue output (+20mADC)	• 2-channel	M O A2		Х	
8	Dual analogue output (+10VDC)	• 2-channel	M O V2		Х	
9	RS485 / RS232 port module	• Max. 115.2 Kbps	M C 485 232			х
10	Ethernet port module	• RJ45 10/100 BaseT	M C ETH			x
11	BACnet-IP port module	Based on Ethernet bus	M C BAC IP			х
12	BACnet-MS/TP port module	• Over RS485	M C BAC MS			х
13	Ethernet/IP	Based on Ethernet	MCEI			х
14	Profibus module	Profibus DP V0 Over RS485	МСРВ			х

NOTE:

The position of the modules shall respect the sequence A-B-C. Possible arrangements are M, M-A, M-B, M-C, M-A-B, M-A-C, M-B-C and M-A-B-C where "M" is the basic module.

It is possible to use the WM30-96 without any additional module as a simple indicator.





Input specifications

Rated inputs	System type: 1, 2 or	Energy
Input type	3-phase Galvanic insulation by means of built-in CT's	Influenc
Current range (by CT)	AV5 and AV6: 5(6)A	
	AV4 and AV7: 1(2)A	Total Ha
Voltage (by direct connection or VT/PT)	AV4, AV5: 400/690VLL; AV6, AV7: 100/208VLL	
Accuracy (Display + RS485) (@25°C ±5°C,		
(@200100, R.H. ≤60%, 48 to 62 Hz)	In: see below, Un: see below	
AV4 model	In: 1A, Imax: 2A; Un: 160 to 480VLN (277 to 830VLL)	
AV5 model	In: 5A, Imax: 6A; Un: 160 to 480VLN (277 to 830VLL)	
AV6 model	In: 5A, Imax: 6A; Un: 40 to 144VLN (70 to	Tempe
AV7 model	250VLL) In: 1A, Imax: 2A; Un: 40 to	Sampli
Current AV4, AV5, AV6, AV7	144VLN (70 to 250VLL)	Measu
models	From 0.01In to 0.05In: ±(0.5% RDG +2DGT)	Metho
	From 0.05In to Imax: ±(0.2% RDG +2DGT)	Coupl
Phase-neutral voltage	In the range Un: $\pm(0,2\%)$ RDG +1DGT)	Crest fa
Phase-phase voltage	In the range Un: ±(0.5% RDG +1DGT)	
Frequency Active and Apparent power	±0.01Hz (45 to 65Hz) From 0.01In to 0.05In, PF	Curren Contir
· ····· · ···· · · · · · · · · · · · ·	1: ±(1%RDG+1DGT) From 0.05In to Imax	Contir For 50
	PF 0.5L, PF1, PF0.8C:	For 50
Power Factor	±(0.5%RDG+1DGT) ±[0.001+0.5% (1.000 - "PF RDG")]	Voltage Contir For 50
Reactive power	From 0.02In to	Input in
	0.05In, senφ 1: ±(1.5%RDG+1DGT)	400VL 208VL
	From 0.05In to Imax, senφ 1: ±(1%RDG+1DGT)	5(6)A 1(2)A
	From 0.05In to	Freque
	0.1In, senφ 0.5L/C: ±(1.5%RDG+1DGT)	
	From 0.1In to Imax, senφ 0.5L/C: ±(1%RDG+1DGT)	
Active energy	Class 0.5S according to EN62053-22, ANSI C12.20	
	Class C according to	
Reactive energy	EN50470-3. Class 2 according to	
Start up current AV5, AV6	EN62053-23, ANSI C12.1. 5mA	
Start up current AV4, AV7	1mA	

Energy additional errors	According to EN62053-22, ANSI C12.20,
Influence quantities	Class B or C according to EN50470-3, EN62053-23, ANSI C12.1
Total Harmonic Distortion (THD)	±1% FS (FS: 100%) AV4: Imin: 5mARMS; Imax: 3A; Umin: 30VRMS; Umax: 679Vp AV5: Imin: 5mARMS; Imax: 15Ap; Umin: 30VRMS; Umax: 679Vp AV6: Imin: 5mARMS; Imax: 15Ap; Umin: 30VRMS; Umax: 204Vp AV7: Imin: 5mARMS; Imax: 3A; Umin: 30VRMS; Umax: 204Vp
Temperature drift	≤200ppm/°C
Sampling rate	3200 samples/s @ 50Hz, 3840 samples/s @ 60Hz
Measurements Method	See "List of the variables that can be connected to:" TRMS measurements of
Coupling type	distorted wave forms. By means of CT's
Crest factor	AV5, AV6: ≤3 (15A max. peak) AV4, AV7: ≤3 (3A max. peak)
Current Overloads Continuous (AV5 and AV6) Continuous (AV4 and AV7) For 500ms (AV5 and AV6) For 500ms (AV4 and AV7)	6A, @ 50Hz 2A, @ 50Hz 120A, @ 50Hz 40A, @ 50Hz
Voltage Overloads Continuous For 500ms	1.2 Un 2 Un
Input impedance 400VL-L (AV4 and AV5) 208VL-L (AV6 and AV7) 5(6)A (AV5 and AV6) 1(2)A (AV4 and AV7)	> 1.6MΩ > 1.6MΩ < 0.2VA < 0.2VA
Frequency	40 to 440 Hz



Output specifications

Relay outputs (M O R2)	- /	Pulse type	Programmable from 0.001
Physical outputs	2 (max. 1 module per		to 10.00 kWh/kvarh per
Purpose	instrument) For either alarm output or		pulse. The above listed
i dipodo	pulse output		variables can be connected to any output.
Туре	Relay, SPDT type	Pulse duration	≥100ms < 120msec (ON),
	AC 1-5A @ 250VAC; AC		≥120ms (OFF), according
Configuration	15-1.5A @ 250VAC By means of the front key-		to EN62052-31
Comgulation	pad	Remote controlled outputs	The activation of the outputs is managed
Function	The outputs can work as		through the serial
	alarm outputs but also		communication port
	as pulse outputs, remote controlled outputs, or in	Insulation	See "Insulation between
	any other combination.		inputs and outputs" table
Alarms	Up alarm and down alarm	20mA analogue outputs (M O A2)	
	linked to the virtual alarms,	Number of outputs	2 per module (max. 1
	other details see Virtual alarms	·	module per instrument)
Min. response time	≤200ms, filters excluded.		.0.00/ 50
-	Set-point on-time delay: "0 s".	(@ 25°C ±5°C, R.H. ≤60%) Range	±0.2%FS 0 to 20mA
Pulse		Configuration	By means of the front key-
Signal retransmission	Total: +kWh, -kWh, +kvarh, -kvarh.		pad
	Partial: +kWh, -kWh,	Signal retransmission	The signal output can
- · · ·	+kvarh, -kvarh.		be connected to any instantaneous variable
Pulse type	Programmable from 0.001		available in the table "List
	to 10.00 kWh/kvarh per pulse.The above listed		of the variables that can be
	variables can be connected	Societar fostor	connected to".
	to any output.	Scaling factor	Programmable within the whole range of
Pulse duration	≥100ms <120msec (ON), ≥120ms (OFF), according		retransmission.
	to EN62052-31	Response time	≤400 ms typical (filter
Remote controlled		Pipplo	excluded) ≤1% (according to IEC
outputs	The activation of the	Ripple	60688-1, EN 60688-1)
	outputs is managed through the serial	Total temperature drift	≤500 ppm/°C
	communication port	Load	≤600Ω
Insulation	See "Insulation between	Insulation	See "Insulation between inputs and outputs" table
	inputs and outputs" table	10VDC analogue outputs	
Static outputs (M O O2)	Opto-Mos type	(M O V2)	
Physical outputs	2 (max. 1 module per instrument)	Number of outputs	2 (max. 1 module per
Purpose	For either pulse output or	A = =	instrument)
	alarm output	Accuracy (@ 25°C ±5°C, R.H. ≤60%)	±0.2%FS
Signal	V _{ON} : 2.5VAC/DC/max.100mA V _{OFF} : 42VDC max.	Range	0 to 10 VDC
Configuration	By means of the front key-	Configuration	By means of the front key-
e ega. au e	pad	Signal retransmission	pad
Function	The outputs can work as	Signal retransmission	The signal output can be connected to any
	alarm outputs but also		instantaneous variable
	as pulse outputs, remote controlled outputs, or in		available in the table "List
	any other combination.		of the variables that can be
Alarms	Up alarm and down alarm	Scaling factor	connected to". Programmable within
	linked to the virtual alarms,		the whole range of
	other details see Virtual alarms		retransmission;
Min. response time	≤200ms, filters excluded.	Response time	≤400 ms typical (filter
-	Set-point on-time delay: "0	Ripple	excluded) ≤1% (according to IEC
Pulse	s".		60688, EN 60688)
Signal retransmission	Total: +kWh, -kWh, +kvarh,	Total temperature drift	≤350 ppm/°C
5	-kvarh.	Load Insulation	≥10kΩ See "Insulation between
	Partial: +kWh, -kWh,	moulation	inputs and outputs" table
	+kvarh, -kvarh.		,



Output specifications (cont.)

RS485 (on request)		Ethernet/Internet port	
Туре	Multidrop, bidirectional	(on request)	
	(static and dynamic	Protocols	Modbus TCP/IP
	variables)	IP configuration	Static IP / Netmask /
Connections	2-wire		Default gateway
	Max. distance 1000m,	Port	Selectable (default 502)
	termination directly on the	Client connections	Max 5 simultaneously
A data a sa s	module	Connections	RJ45 10/100 BaseTX
Addresses	247, selectable by means		Max. distance 100m
Protocol	of the front key-pad	Data (bidirectional)	Quetere enductor
Protocol Data (bidirectional)	MODBUS/JBUS (RTU)	Dynamic (reading only)	System and phase variables: see table "List of
Dynamic (reading only)	System and phase		variables"
Dynamic (reading only)	variables: see table "List of	Static	variables
	variables"	(reading and writing only)	All the configuration
Static (reading and writing only)	All the configuration	(reading and writing only)	parameters.
	parameters.	Note	With the rotary switch
Data format	1 start bit, 8 data bit, no/	Note	(on the back of the basic
	even/odd parity,1 stop bit		unit) in lock position
Baud-rate	Selectable: 9.6k, 19.2k,		the modification of the
	38.4k, 115.2k bit/s		programming parameters
Driver input capability	1/5 unit load. Maximum		and the reset command
-	160 transceivers on the		by means of the serial
	same bus.		communication is not
Note	With the rotary switch		allowed anymore. In this
	(on the back of the basic		case just the data reading
	unit) in lock position		is allowed.
	the modification of the	Insulation	See "Insulation between
	programming parameters		inputs and outputs" table
	and the reset command	BACnet-IP	
	by means of the serial communication is not	(on request)	
	allowed anymore. In this	Protocols	BACnet-IP (for
	case just the data reading		measurement reading
	is allowed.		purpose and to write object
Insulation	See "Insulation between		description) and Modbus
litediation	inputs and outputs" table		TCP/IP (for measurement
RS232 port (on request)			reading purpose and for
Type	Bidirectional (static and		programming parameter
Турс	dynamic variables)	BACnet-IP	purpose)
Connections	3 wires. Max. distance 15m	IP configuration	Static IP / Netmask /
Protocol	MODBUS RTU /JBUS	II coniguration	Default gateway
Data (bidirectional)		Port	Fixed: BAC0h
Dynamic (reading only)	System and phase	Device object instance	
,,,			U to 9999 selectable by
	variables: see table "List of	Device object instance	0 to 9999 selectable by key-pad 0 to 2^22-2 =
	variables"		key-pad 0 to $2^{22-2} =$ 4.194.302, selectable by
Static (reading and writing only)	variables"		key-pad 0 to 2^22-2 = 4.194.302, selectable by
	variables" All the configuration parameters		key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet.
Static (reading and writing only) Data format	variables" All the configuration parameters 1 start bit, 8 data bit, no/	Supported services	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet.
Data format	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit		key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple)
	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k,	Supported services	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property"
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s		key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value,
Data format	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch	Supported services	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property),
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic	Supported services	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position	Supported services	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position the modification of the	Supported services	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm re-transmission) Type 8
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters	Supported services Supported objects	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm re-transmission) Type 8 (device)
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command	Supported services	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm re-transmission) Type 8 (device) Static IP / Netmask /
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial	Supported services Supported objects IP configuration	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm re-transmission) Type 8 (device) Static IP / Netmask / Default gateway
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not	Supported services Supported objects	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm re-transmission) Type 8 (device) Static IP / Netmask / Default gateway See "Ethernet/Internet port"
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this	Supported services Supported objects IP configuration Modbus TCP/IP	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm re-transmission) Type 8 (device) Static IP / Netmask / Default gateway See "Ethernet/Internet port" above
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not	Supported services Supported objects IP configuration	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm re-transmission) Type 8 (device) Static IP / Netmask / Default gateway See "Ethernet/Internet port" above Modbus only: max 5
Data format Baud-rate	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this case just the data reading	Supported services Supported objects IP configuration Modbus TCP/IP Client connections	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm re-transmission) Type 8 (device) Static IP / Netmask / Default gateway See "Ethernet/Internet port" above Modbus only: max 5 simultaneously
Data format Baud-rate Note	variables" All the configuration parameters 1 start bit, 8 data bit, no/ even/odd parity,1 stop bit Selectable: 9.6k, 19.2k, 38.4k, 115.2k bit/s With the rotary switch (on the back of the basic unit) in lock position the modification of the programming parameters and the reset command by means of the serial communication is not allowed anymore. In this case just the data reading is allowed.	Supported services Supported objects IP configuration Modbus TCP/IP	key-pad 0 to 2^22-2 = 4.194.302, selectable by programming software or by BACnet. "I have", "I am", "Who has", "Who is", "Read (multiple) Property" Type 2 (analogue value, including COV property), Type 5 (binary-value for up to 16 virtual alarm re-transmission) Type 8 (device) Static IP / Netmask / Default gateway See "Ethernet/Internet port" above Modbus only: max 5



Output specifications (cont.)

Data Dynamic (reading only)	System and phase	Connections	RJ45 10/100 BaseTX Max. distance 100m
Dynamic (rodaing only)	variables (BACnet-IP and	Data	
	Modbus): see table "List of	Dynamic (reading only)	System and phase
Static	variables"		variables: see table "List of variables"
(reading and writing only)	All the configuration		vanables
	parameters (Modbus only)	Static	
Note	With the rotary switch (on the basic	(reading and writing only)	All the configuration
	unit) in lock position	Note	parameters (Modbus only). With the rotary switch
	the modification of the		(on the back of the basic
	programming parameters and the reset command		unit) in lock position
	by means of the serial		the modification of the programming parameters
	communication is not		and the reset command
	allowed anymore. In this case just the data reading		by means of the serial communication is not
	is allowed.		allowed anymore. In this
Insulation	See "Insulation between		case just the data reading
BACnet MS/TP (on request)	inputs and outputs" table	Insulation	is allowed. See "Insulation between
Available ports	2: RS485 and Ethernet	mediciteri	inputs and outputs" table
RS485 port		Approval	BTL
Туре	Multidrop, mono-directional (dynamic variables)	Ethernet/IP (on request)	
Connections	2-wire Max. distance	Protocols	Ethernet/IP (for measurement reading
	1000m, termination directly on the module		purpose) and Modbus
Device object instance	0 to 9999 selectable by		TCP/IP (for programming
2	key-pad	IP configuration	parameter purpose) Static IP / Netmask /
	0 to $2^2-2 = 4.194.302$, selectable by programming	-	Default gateway
	software or by BACnet.	Modbus Port	Selectable (default 502) Modbus only: max 5
Protocol	BACnet MS/TP (for measurement reading		simultaneously RJ45
	purpose and to write object		10/100 Base TX Max distance 100m
	description)	Ethernet/IP port	
Supported services	"I have", "I am", "Who has", "Who is", "Read (multiple)	Topology	Star RJ45 standard
	Property"		Max distance 100m
Supported objects	Type 2 (analogue value, including COV property),	Level	Commercial level
	Type 5 (binary-value for	Connection	Connection establishment: target
	up to 16 virtual alarm re-transmission)	Messaging	Class 1 and class 3
	Type 8 (device)	Supported features	messanging ACD (Address Conflict
Data (mono-directional)		Supported leatures	Detection)
Dynamic	System and phase variables: see table "List of		
	variables"		List service 0x0004 List identity 0x0063
Static Data format	Not available 1 start bit, 8 data bit, no		Register session 0x0065
Bata Ionnat	parity,1 stop bit		Unregister session 0x0066 Send RR data 0x006F
Baud-rate	Selectable: 9.6k, 19.2k,		Send Unit Data 0x0070
Driver input capability	38.4k or 76.8k kbit/s 1/5 unit load. Maximum	Data	System and phase
	160 transceivers on the	Dynamic (reading only)	System and phase variables (Ethernet/IP):
MAC addresses	same bus. Selectable: 0 to 127		see Ethernet/IP protocol
Ethernet port		Static	document
Protocol	Modbus TCP/IP (for	(reading and writing only)	All the configuration
	programming parameter purpose)	/	parameters (Modbus TCP
IP configuration	Static IP / Netmask /	Insulation	only) See "Insulation between
Modbus Port	Default gateway Selectable (default 502)		inputs and outputs" table
Client connections	Modbus only: max 5	Approval	Ethernet IP conformance tested (ODVA)
	simultaneously		

Output specifications (cont.)

Profibus (MCPB)		Connector	RS485 DB9
Available ports	2: USB and Profibus DP V0	Protocol	Profibus DP V0 slave
USB		Baudrate	9.6 k to 12 Mbps (9.6,
Purpose	Programmable parameters	Badalato	19.2, 45.45, 93.75, 187.5,
I	setting		or 500 kbps; 1.5, 3, 6, or
Connector	USB micro B		12 Mbps)
Protocol	Modbus RTU	Address	2-125 (default 126)
Data format	1 start bit, 8 data bit,	Note	With the rotary switch
	no parity,1 stop bit	Note	(on the back of the basic
Baudrate	autorange depending on		unit) in lock position
	the master (max		the modification of the
	115200 bps)		programming parameters
Address	1		and the reset command
Profibus			by means of the serial
Purpose	Data reading (12		communication is not
	programmable profiles		allowed. In this case just
	realtime selectable);		the data reading is allowed.
	remote output control;	Insulation	See "Insulation between
	remote tariff control;	Insulation	inputs and outputs" table
Modules Selectable:	output up to 4 bytes, input		inputs and outputs table
	up to 62 words		
Data format (profiles)	totalizers : FLOAT or		
Bata format (promot)	INT32;		
	electrical variables: FLOAT		
	or INT16;		
	status variables : UINT16		

Energy meters

Meters Total Partial	4 (9+1 digit) 4 (9+1 digit)		Min9,999,999,999 kWh/ kvarh Max. 9,999,999,999 kWh/ kvarh.
Pulse output	Connectable to total and/or partial meters	Туре	
Energy meter recording	Storage of total and partial energy meters. Energy meter storage format (EEPROM)	Total energy meters Partial energy meters	+kWh, +kvarh, -kWh, -kvarh +kWh, +kvarh, -kWh, -kvarh

Harmonic distortion analysis

Analysis principle Harmonic measurement	FFT		The same for the other phases: L2, L3.
Current Voltage	Up to the 32nd harmonic Up to the 32nd harmonic	System	The harmonic distortion can be measured in 3-wire
Type of harmonics	THD (VL1 and VL1-N) The same for the other phases: L2, L3. THD (AL1)		or 4-wire systems. Tw: 0.02 sec@50Hz without filter



Display, LED's and commands

Display refresh time	≤ 250 ms	Energy consumption	Red LED (only kWh)
Display	4 lines, 4-DGT, 1 lines, 10-DGT	kWh pulsating	0.001 kWh/kvarh by pulse if the Ct ratio by VT ratio is
Туре	LCD, single colour backlight		≤7 0.01 kWh/kvarh by pulse if
Digit dimensions	4-DGŤ: h 9.5mm; 10-DGT: h 6.0mm		the Ct ratio by VT ratio is ≥7.1 ≤70.0
Instantaneous variables read-out Energies variables read-out	4-DGT Imported Total/Partial: 8+2DGT, 9+1DGT or 10DGT; Exported Total/Partial: 8+2DGT, 9+1DGT or 10DGT (with "-" sign).		0.1 kWh/kvarh by pulse if the Ct ratio by VT ratio is ≥70.1 ≤700.0 1 kWh/kvarh by pulse if the Ct ratio by VT ratio is ≥700.1 ≤7000 10 kWh/kvarh by pulse if
Run Hours counter	8+2 DGT (99.999.999 hours and 59 minutes max)		the Ct ratio by VT ratio is ≥7001 ≤70.00k
Overload status	EEEE indication when the value being measured is exceeding the "Continuous inputs overload" (maximum measurement capacity)		100 kWh/kvarh by pulse if the Ct ratio by VT ratio is >70.01k Max frequency: 16Hz, according to EN50470-1
Max. and Min. indication	Max. instantaneous variables: 9999; energies: 9 999 999 999. Min. instantaneous variables: 0.000; energies 0.0	Back position LEDs On the base On the communication modules	Green as power-on Two LEDs: one for TX (green) and one for RX (amber).
Front position LEDs Virtual alarms	4 red LED available in case of virtual alarm (AL1-AL2- AL3-AL4). Note: the real alarm is just the activation of the proper static or relay output if the proper module is available.	Key-pad	For variable selection, programming of the instrument working parameters, "dmd", "max", total energy and partial energy Reset

Main functions

Password	Numeric code of max. 4 digits; 2 protection levels of the programming data:	System 3-Ph.2 balanced load	3-phase (2-wire), one current and 1-phase (L1) to neutral voltage
1st level	Password "0", no protection;	System 2-Ph	measurement. 2-phase (3-wire)
2nd level	Password from 1 to 9999,	System 1-Ph	1-phase (2-wire)
	all data are protected	Transformer ratio	
System selection		VT (PT)	1.0 to 999.9 /
System 3-Ph.n unbalanced load	3-phase (4-wire)	СТ	1000 to 9999.
System 3-Ph. unbalanced load	3-phase (3-wire), three	CI	1.0 to 999.9 / 1000 to 9999 (up to 10kA in case of CT
	currents and 3-phase to phase voltage		with 1A secondary current
	measurements, or in case		and up to 50kA in case
	of Aaron connection two		of CT with 5A secondary
	currents (with special		current).
	wiring on screw terminals)	Filter	
	and 3-phase to phase	Operating range	Selectable from 0 to 100%
	voltage measurements.		of the input display scale
System 3-Ph.1 balanced load	3-phase (3-wire), one	Filtering coefficient	Selectable from 1 to 32
	current and 3-phase to phase voltage	Filter action	Measurements, analogue
	measurements		signal retransmission, serial communication
	3-phase (4-wire), one		(fundamental variables:
	current and 3-phase		V, A, W and their derived
	to neutral voltage		ones).
	measurements.		



Main functions (cont.)

Displaying Number of variables	Up to 5 variables per page. See "Front view". 7 different set of variables available (see "Display pages") according to the application being selected. One page is freely programmable as	Harmonic analysis Clock	values. - total energies: kWh, kvarh; - partial energies: kWh, kvarh Up to the 32 nd harmonics on current and voltage
Backlight The backlight	combination of variables. time is programmable from 0	Functions Time format	Universal clock and calendar. Hour: minutes: seconds
	(always on) to 255 minutes		with selectable 24 hours or 12H AM/PM format.
Virtual alarms Working condition	In case of basic unit or with the addition of M O R2	Date format	Day-month-year with selectable DD-MM-YY or MM-DD-YY format.
	or M O O2 digital output modules.	Battery life	10 years
No. of alarms Working mode Controlled variables	Up to 4 Up alarm and down alarm. The alarms can be connected to any instantaneous variable available in the table "List of the variables that can be connected to".	Easy programming function	For all the display selections, both energy and power measurements are independent from the current direction. The displayed energy is always "imported" with the only exception of "C", "D",
Set-point adjustment	From 0 to 100% of the display scale		"E" and "G" types (see "display pages" table). For those latter selections the
Hysteresis	From 0 to 100% of the display scale		energies can be either
On-time delay	0 to 255s		"imported" or "exported"
Min. response time	≤ 200ms, filters excluded. Set-point on-time delay: "0 s".		depending on the current direction.
Reset	By means of the front key- pad. It is possible to reset the following data: - all the max and dmd		

General specifications

Operating temperature	-25°C to +55°C (-13°F to 131°F) (R.H. from 0 to 90% non-condensing @ 40°C) according to EN62053-21, EN50472 4, and EN62052	EMC Electrostatic discharges Immunity to irradiated electromagnetic fields	According to EN62052-11 15kV air discharge Test with current: 10V/m
Storage temperature	EN50470-1 and EN62053- 23 -30°C to +70°C (-22°F to 158°F) (R.H. < 90% non-condensing @ 40°C) according to EN62053-21, EN50470-1 and EN62053- 23	Burst Immunity to conducted disturbances	from 80 to 2000MHz Test without any current: 30V/m from 80 to 2000MHz On current and voltage measuring inputs circuit: 4kV 10V/m from 150KHz to
Installation category	Cat. III (IEC60664, EN60664)	Surge	80MHz On current and voltage
Insulation (for 1 minute) Dielectric strength	See "Insulation between inputs and outputs" table 4kVAC RMS for 1 minute	Radio frequency suppression	measuring inputs circuit: 4kV; on "L" auxiliary power supply input: 1kV According to CISPR 22
Noise rejection CMRR	100 dB, 48 to 62 Hz		



General specifications (cont.)

Standard compliance		Housing DIN					
Safety	IEC60664, IEC61010-1	Dimensions (WxHxD)	Module holder:				
2	EN60664, EN61010-1		96x96x50mm.				
	EN62052-11.		"A" and "B" type modules:				
Metrology	EN62053-22, EN62053-23,		89.5x63x16mm.				
menergy	EN50470-3.		"C" type module:				
Pulse output	DIN43864, IEC62053-31		89.5x63x20mm.				
I	,	Max. depth behind the panel	With 3 modules (A+B+C):				
Approvals	Eligible System	Max. deput berning the parter	81.7 mm				
	performance Meter for Go	Material	• · · · · · · · · · · · · · · · · · · ·				
	Solar California, CE, cULus	Wateria	ABS/Nylon PA66, self-				
	"Listed"	Manual in a	extinguishing: UL 94 V-0				
Connections	Screw-type	Mounting	Panel mounting				
Cable cross-section area	max. 2.5 mm^2 .	Protection degree					
	min./max. screws tightening	Front	IP65, NEMA4x, NEMA12				
	torque: 0.4 Nm / 0.8 Nm.	Screw terminals	IP20				
	Suggested screws	Weight	Approx. 420 g (packing				
	tightening torque: 0.5 Nm	5	included)				
	5 5 4		,				

Insulation between inputs and outputs

	Power Supply (H o L)	Mesuring inputs	Relè output (MOR2)	Static ouput (MOO2)	Serial port	Ethernet port	Analogue outputs
Power Supply (H o L)	-	4kV	4kV	4kV	4kV	4kV	4kV
Mesuring inputs	4kV	-	4kV	4kV	4kV	4kV	4kV
Relè output (MOR2)	4kV	4kV	2kV	-	4kV	4kV	4kV
Static ouput (MOO2)	4kV	4kV	-	2kV	4kV	4kV	4kV
Serial port	4kV	4kV	4kV	4kV	-	-	4kV
Ethernet port	4kV	4kV	4kV	4kV	-	-	4kV
Analogue outputs	4kV	4kV	4kV	4kV	4kV	4kV	4kV ⁽¹⁾

(1): respect another module 4kV, in the same module 0kV.

-: combination not allowed.

NOTE: all the models have, mandatory, to be connected to external current transformers because the isolation among the current inputs is just functional (100VAC).



List of the variables that can be connected to:

Communication port (all listed variables)
Analogue outputs (all variables with the only exclusion of "energies" and "run hour counter"
Pulse outputs (only "energies")
Alarm outputs ("energies", "hour counter" and "max" excluded)

No	Variable	1-ph.		3-ph. 3/4-wire		3-ph. 3-wire	3-ph. 4-wire	Notes
1	VL-N sys	sys O	sys X	balanced sys		unbal. sys #	unbal. sys	sys= system= ∑
2	VL-N Sys	X	X	X	X X	#	XX	sys-system-
3	VL1 VL2	0	X	X	X	#	X	
4	VL2 VL3	0	Ô	X	X	#	X	
5	VL5 VL-L sys	0	#	X	X	# X	X	sys= system= ∑
6	VL1-2	#	ж Х	X	X	X	X	sys- system- Z
7	VL2-3	#	0	X	X	X	X	
8	VL3-1	#	0	X	X	X	X	
9	Asys		X	0	0	X	X	
10	Asys	#	X	0	0	0	X	
11	AL1	<i>#</i> Х	X	x	X	X	X	
12	AL1 AL2	0	X	X	X	X	X	
13	AL2 AL3	0	Ô	X	X	X	X	
13	VA sys	X	X	X	X	X	X	sys= system= ∑
14	VA Sys VA L1	X	X	X	X	#	X	sys- system- Z
16	VAL1 VAL2	0	X	X	X	#	X	
17	VA L2 VA L3	0	0	X	× X	#	X	
18		X	X	X	X	#X	X	sys= system= ∑
10	var sys var L1	 Х	X	X	× X	#	X	sys- system- Z
20	var L1	0	X	X	X	#	X	
20	var L2	0	0	X	X	#	X	
21	W sys	X	X	X	X	#X	X	sys= system= ∑
22	WL1	 Х	X	X	X	#	X	sys- system- Z
23	WL2	0	X	X	X	#	X	
24	WL3	0	0	X	X	#	X	
25	PF sys	X	X	X	X	ж Х	X	sys= system= ∑
20	PF L1	X	X	x	X	#	X	sys-system-Z
28	PF L2	0	X	X	X	#	X	
29	PF L3	0	Ô	X	X	#	X	
30	Hz	X	X	X	X	#X	X	
31	Phase seq.	0	X	X	X	X	X	
32	Asy VLL	0	0	X	X	X	X	Asymmetry
33	Asy VLN	0	x	#	0	#	X	Asymmetry
34	Run Hours	X	X	 Х	X	** X	X	Asymmetry
35	kWh (+)	X	X	X	X	X	X	Total
36	kvarh (+)	X	X	X	X	X	X	Total
37	kWh (+)	X	X	X	X	X	X	Partial
38	kvarh (+)	X	X	X	X	X	X	Partial
39	kWh (-)	X	X	X	X	X	X	Total
40	kvarh (-)	X	X	X	X	X	X	Total
41	kWh (-)	X	X	X	X	X	X	Partial
42	kvarh (-)	X	X	X	X	X	X	Partial
43	A L1 THD	X	X	X	X	X	X	
44	A L2 THD	0	X	X	X	X	X	
44	A L2 THD	0	0	X	X	X	X	
45	V L1 THD	X	X	X	X	0	X	
40	V L2 THD	0	X	X	X	0	X	
47	V L2 THD V L3 THD	0	0	X	X	0	X	
40	V L3 THD V L1-2 THD	X	X	X	X	X	× X	
49 50	V L1-2 THD V L2-3 THD	0	X	X	X	X	X	
50	V L2-3 THD V L3-1 THD	0	0	X	X	X	× X	
51					^	<u>^</u>	^	

(X) = available; (O) = not available (variable not available on the display); (#) Not available (the relevant page is not displayed)



Power supply specifications

Auxiliary	power	supply
/ ca/cillial y	powor	ouppiy

H: 100-240 +/-10% (90 to 255) VDC/AC (50/60 Hz); L: 24-48 +/-15% (20 to 55) VDC/AC (50/60 Hz)

Power consumption

AC: 20 VA; DC: 10 W

List of selectable applications

	Description	Notes
Α	Cost allocation	Imported energy metering
В	Cost control	Imported and partial energy metering
С	Complex cost allocation	Imported/exported energy (total and partial)
D	Solar	Imported and exported energy metering with some basic power analyzer function
Е	Complex cost and power analysis	Imported/exported energy (total and partial) and power analysis
F	Cost and power quality analysis	Imported energy and power quality analysis
G	Advanced energy and power analysis for power generation	Complete energy metering and power quality analysis

Display pages

Var		Line 1	Line 2	Line 3	Line 4	Line 5		Applications							
Туре	No	Variable Type	Variable Type	Variable Type	Variable Type	Variable Type	Note	A	В	C	D	Ε	F	G	
	0	Home page		Progra	mmable			x	х	х	х	х	х	х	
а	1	Total kWh (+)	b, c, d	b, c, d	b, c, d	b, c, d		x	x	х	х	х	х	х	
а	2	Total kvarh (+)	b, c, d	b, c, d	b, c, d	b, c, d		x	х	х	х	х	х	х	
а	3	Total kWh (-)	b, c, d	b, c, d	b, c, d	b, c, d				х	х	х		х	
а	4	Total kvarh (-)	b, c, d	b, c, d	b, c, d	b, c, d				х	х	х		х	
а	5	kWh (+) partial	b, c, d	b, c, d	b, c, d	b, c, d			x	х		х	х	х	
а	6	kvarh (+) part.	b, c, d	b, c, d	b, c, d	b, c, d			х	х		х	х	х	
а	7	kWh (-) partial	b, c, d	b, c, d	b, c, d	b, c, d				х		х		х	
а	8	kvarh (-) part.	b, c, d	b, c, d	b, c, d	b, c, d				х		х		х	
а	9	Run Hours (999999999.99)	b, c, d	b, c, d	b, c, d	b, c, d				x	х	x	x	x	
b	10	a/Phase seq.	VLN Σ	VL1	VL2	VL3	(1) (2)				х	х	х	х	
b	11	a/Phase seq.	VLN Σ	VL1-2	VL2-3	VL3-1	(1) (2)				х	х	х	х	
b	12	a/Phase seq.	An	AL1	AL2	AL3	(1) (2)				х	х	х	х	
b	13	a/Phase seq.	Hz	"ASY"	VLL sys (% asy)	VLL sys (% asy)	(1) (2)				х	х	х	x	
b	14	a/Phase seq.	AΣ	AL1	AL2	AL3	(1) (2)				х	х	х	x	
С	15	a/Phase seq.	WΣ	WL1	WL2	WL3	(1) (2)				х	х	х	х	
С	16	a/Phase seq.	var ∑	var L1	var L2	var L3	(1) (2)					х	х	х	
С	17	a/Phase seq.	PF ∑	PF L1	PF L2	PF L3	(1) (2)					х	х	х	
С	18	a/Phase seq.	να Σ	VA L1	VA L2	VA L3	(1) (2)					х	х	х	
d	19	a/Phase seq.		THD V1	THD V2	THD V3	(1) (2)						х	х	
d	20	a/Phase seq.		THD V12	THD V23	THD V31	(1) (2)						х	х	
d	21	a/Phase seq.		THD A1	THD A2	THD A3	(1) (2)						х	х	

Note: the table refers to system 3P.n.

(1) Also maximum value storage (no EEPROM storage).

(2) Also average (dmd) value (no EEPROM storage).

Ne	Line 4			Line C	Nate	Applications							
No	Line 1	Line 2	Line 3	Line 4	Line 5	Note	Α	В	C	D	Ε	F	G
1	Lot n. (text) xxxx	Yr. (text) xx	SYS (text)	x (1/2/3)	160 (min) "dmd"		х	х	х	х	х	х	х
2	Conn. xxx.x (3ph.n/3ph/3ph./ 3ph.2/1ph/2ph)	CT.rA (text)	1.0 99.99k	PT.rA (text)	1.09999		x	x	x	x	x	x	x
3	LED PULSE (text) kWh	xxxx kWh per pulse					x	x	x	x	x	x	x
4	PULSE out1 (text) kWh/kvarh	xxxx kWh/kvarh per pulse	+/- tot/PAr				x	x	x	x	x	x	x
5	PULSE out2 (text) kWh/kvarh	xxxx kWh/kvarh per pulse	+/- tot/PAr				x	x	x	x	x	x	x
6	Remote out	out1 (text)	on/oFF	Out2 (text)	on/oFF		х	х	х	х	х	х	х
7	Alarm 1 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					х	x	x	x
8	Alarm 2 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					х	x	x	x
9	Alarm 3 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					x	x	x	x
10	Alarm 4 nE/nd	None / out 1 / out 2	Set 1	Set 2	(measurement)					x	x	x	x
11	Analogue 1	Hi:E	0.0 9999	Hi.A	0.0 100.0%					х	х	х	х
12	Analogue 2	Hi:E	0.0 9999	Hi.A	0.0 100.0%					х	х	х	х
13	COM port	None / out 1 / out 2	xxx (address)	bdr (text)	9.6/19.2/ 38.4/115.2		x	x	x	x	x	x	x
14	IP address	XXX	XXX	XXX	XXX		х	х	х	х	х	х	х


Additional available information on the display


Back protection rotary switch

 Function	Rotary switch position	Description
Unlok	1	All programming parameters are freely modifiable by means of the front key-pad and by means of the communication port.
Lock	7	The key-pad, as far as programming is concerned and the data through the serial communication cannot be changed (no writing into meter allowed). Data reading is allowed.



Accuracy (According to EN50470-3 and EN62053-23)

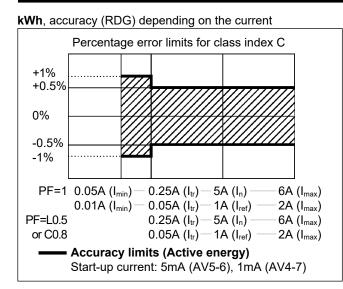

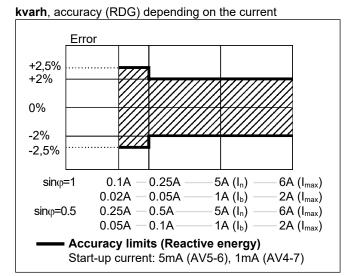

WM3040Soft parameter progr. and var. reading software

WM3040Soft

Multi-language software (Italian, English, French, German, Spanish) for variable reading, instrument calibration and parameters programming.The program runs under Windows XP/ Vista/7

Working mode

Three different working modes can be selected: - management of local RS232 (MODBUS); - management of a local RS485 network (MODBUS); - managed via TCP port

Used calculation formulas

Phase variables

Instantaneous effective voltage

$$\begin{split} V_{1N} &= \sqrt{\frac{1}{n} \cdot \sum_{1}^{n} (V_{1N})_{i}^{2}} \\ \text{Instantaneous active power} \\ W_{1} &= \frac{1}{n} \cdot \sum_{1}^{n} (V_{1N})_{i} \cdot (\mathcal{A}_{1})_{i} \\ \text{Instantaneous power factor} \\ &\cos \varphi_{1} &= \frac{W_{1}}{V\mathcal{A}_{1}} \\ \text{Instantaneous effective current} \\ \mathcal{A}_{1} &= \sqrt{\frac{1}{n} \cdot \sum_{1}^{n} (\mathcal{A}_{1})_{i}^{2}} \\ \text{Instantaneous apparent power} \\ V\mathcal{A}_{1} &= V_{1N} \cdot \mathcal{A}_{1} \end{split}$$

Instantaneous reactive power $var_1 = \sqrt{(VA_1)^2 - (W_1)^2}$

System variables

Equivalent three-phase voltage $V_{\Sigma} = \frac{V_1 + V_2 + V_3}{3} \cdot \sqrt{3}$ Voltage asymmetry $ASY_{LL} = \frac{(V_{LL \max} - V_{LL \min})}{V_{LL} \Sigma}$ $ASY_{LN} = \frac{(V_{LN \max} - V_{LN \min})}{V_{LN} \Sigma}$ Three phase reset

Three-phase reactive power

 $\operatorname{var}_{\Sigma} = \left(\operatorname{var}_{1} + \operatorname{var}_{2} + \operatorname{var}_{3}\right)$

Three-phase active power

 $W_{\Sigma} = W_1 + W_2 + W_3$ Three-phase apparent power

 $VA_{\Sigma} = \sqrt{W_{\Sigma}^2 + \mathrm{var}_{\Sigma}^2}$

Total harmonic distortion

$$THD_{N} = 100 \frac{\sqrt{\sum_{n=2}^{N} |X_{n}|^{2}}}{|X_{1}|}$$

Three-phase power factor $\cos \varphi_{\Sigma} = \frac{W_{\Sigma}}{VA_{\Sigma}}$ (TPF)

Energy metering


$$k \operatorname{var} hi = \int_{t_1}^{t_2} Qi(t) dt \cong \Delta t \sum_{n=1}^{n_2} Qnj$$

$$kWhi = \int_{t_1}^{t_2} Pi(t) dt \cong \Delta t \sum_{n_1}^{n_2} Pnj$$


Where:


i= considered phase (L1, L2 or L3) P= active power; Q= reactive power; t₁, t₂ =starting and ending time points of consumption recording; n= time unit $\Delta_i \Delta t$ = time interval between two successive power consumptions; n₁, n₂ = starting and ending discrete time points of consumption recording

Wiring diagrams





System type selection: 3-Ph.2






System type selection: 3-Ph.n








System type selection: 3-Ph



System type selection: 3-Ph (cont.)












Wiring diagrams

System type selection: 3-Ph.1







System type selection: 2-Ph




System type selection: 2-Ph (cont.)




System type selection: 1-Ph






Power Supply

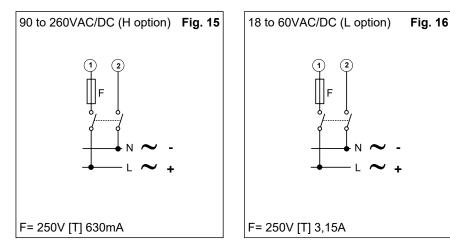




Static, relay and analogue outputs wiring diagrams

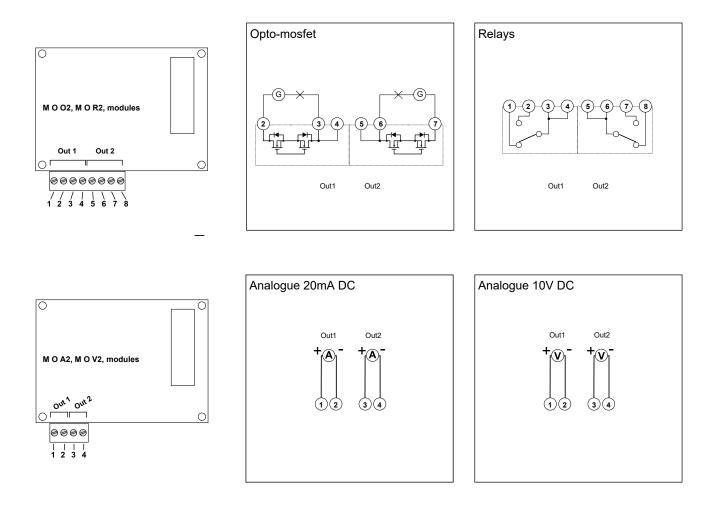


RS485 and RS232 wiring diagrams

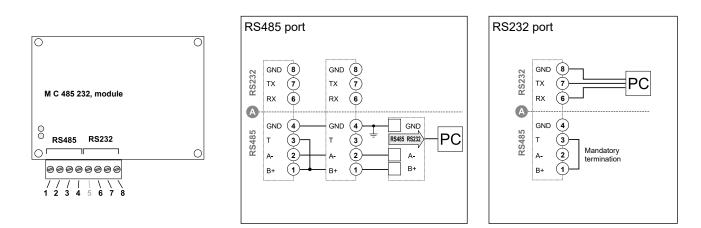

NOTE. RS485: additional devices provided with RS485 are connected in parallel. The termination of the serial output is carried out only on the last instrument of the network, by means of a jumper between (B+) and (T). : the communication RS232 and RS485 ports **can't be** connected and used simultaneously.



RS485 wiring diagram of Bacnet module

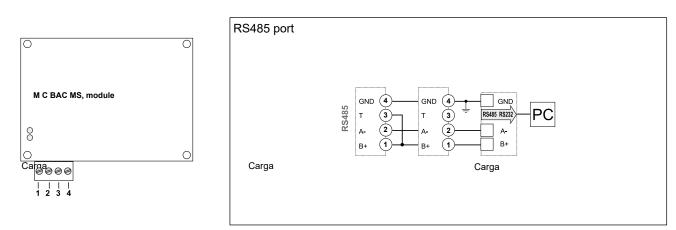


NOTE. RS485: additional devices provided with RS485 are connected in parallel. The termination of the serial output is carried out only on the last instrument of the network, by means of a jumper between (B+) and (T).

Ethernet and BACnet-IP connections




Connection to Ethernet or BACnet modules using the RJ45 connector.

Profibus module connections

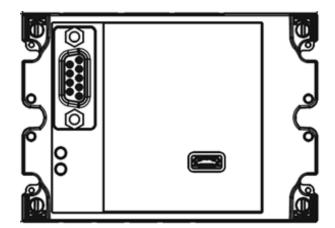

Connection to the Profibus module using USB micro type B (Modbus RTU) and RS485 DB9 (Profibus DP-V0).

Front panel description

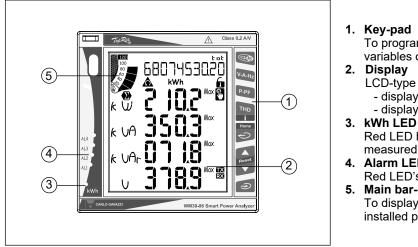


To program the configuration parameters and scroll the variables on the display.

- LCD-type with alphanumeric indications to:
 - display configuration parameters;
- display all the measured variables.
- Red LED blinking proportional to the energy being measured

4. Alarm LED's

- Red LED's light-on when virtual alarms are activated. 5. Main bar-graph
 - To display the power consumption versus the installed power.

Dimensions and Panel cut-out

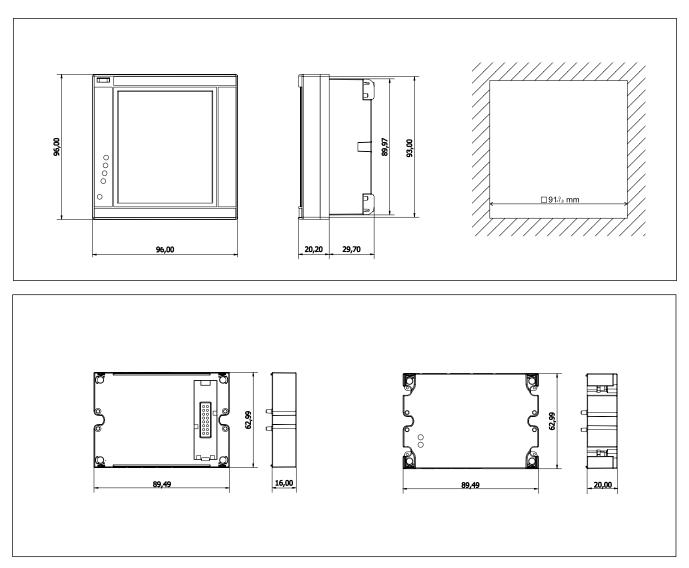

X-ON Electronics

Largest Supplier of Electrical and Electronic Components

Click to view similar products for Power Analysers category:

Click to view products by Carlo Gavazzi manufacturer:

Other Similar products are found below :

AQ1018 AQ1038 AR1039 AD1016H AD1040 MOO2 EM2172DAV63XOSX AQ1042 AD1047 CS-BB3-04 PEL 103 C.A 8220 EM21072DAV63XOSX EM21072DMV53XOSX EM21072DMV63XOSX EM24DINAV53DISX EM28072DMV53X2SX EM28072DMV63X2SX EM50DINAV53HRSX EM50DINRG53HRSX EM50DINMV53HRSX WM1496AV53HDG WM14DINAV63CS FLUKE 345