

# UWP 3.0



## Universal web platform



### Benefits

- **Flexibility.** UWP 3.0 is the core of a powerful system which includes a complete range of meters, sensors and actuators
- **Integration.** UWP 3.0 includes all the necessary software tools to set up and operate the required solution. No subscriptions or additional services are required
- **Interoperability.** By leveraging its automation-server functions, it is easy to exchange data with other systems via FTP, SFTP, FTPS, SMTP, Rest-API, MQTT, Modbus and BACnet
- **Scalability.** It is easy to scale up the system, by leveraging its comprehensive set of monitoring, controlling and communication functions
- **Fast installation and set up.** Each function can be programmed with ease by means of the free configuration tool
- **Reliability.** The system is secure against cyber-attacks and computer viruses. It is the ideal Edge unit for providing local control and data redundancy to distributed applications
- **High storage capability.** Thanks to its 4GB of Storage memory, UWP 3.0 can store complex configurations and log history and events
- **IoT Ready.** UWP 3.0 is Microsoft Azure Certified for IoT
- **Powered by AWS.** UWP 3.0 is compatible with Amazon AWS IoT.
- **Awareness.** By means of scheduled reports and email/SMS alerts, users are constantly advised about installation status
- **Compact Size.** All of the above is available in a 2 DIN module

### Description

UWP 3.0 is a monitoring gateway and controller that allows the monitoring and controlling of installations where Energy Efficiency Management, Building Automation and Car Park Guidance functions are needed.

The system monitors and controls connected devices via its local bus management functions; it includes a web server with a powerful and intuitive user interface to display customised dashboards and interact with local devices and remote systems; the UWP 3.0 embedded automation server allows data to be exchanged locally or remotely via standard Internet protocols.

UWP 3.0 can manage the complete lighting control system based on DALI actuators and it can operate as a BACnet/IP gateway.

### Applications

UWP 3.0 is suitable for applications in Building Automation, Energy Efficiency Performance Management, Car Parking Guidance and all their combinations are suitable application for UWP 3.0. Its comprehensive set of functions, small dimensions and reliability are the key factors for depending on UWP 3.0 as the local monitoring/controlling unit in a wider distributed scenario.

## Main functions


- Monitoring energy control systems so as to check energy efficiency status and improvements.
- Recording, displaying and transmitting information (events and history)
- Defining logical functions, reacting to abnormal conditions and control actuators
- Setting up and operating Building Automation functions
- Setting up and operating Lighting Control functions and DALI
- Setting up and operating Car Parking Guidance systems

## Main features


- Up to 5000 managed signals (including variables, I/Os) shared among Energy Management, Building Automation and Car Park applications\*.
- Up to 128 Modbus devices connected to RS485 ports (64 devices each port).
- Up to 5 users concurrently connected to the Web-App.
- Up to 5 concurrent M2M connections (API connections, BACnet clients, Modbus masters).
- Up to 150 different products from the CG range can be connected to UWP 3.0
- BTL certified.

\*Note: when the Car Park system is active, there will be 2000 signals available for the other applications (Energy Management and Building Automation).

# Architecture

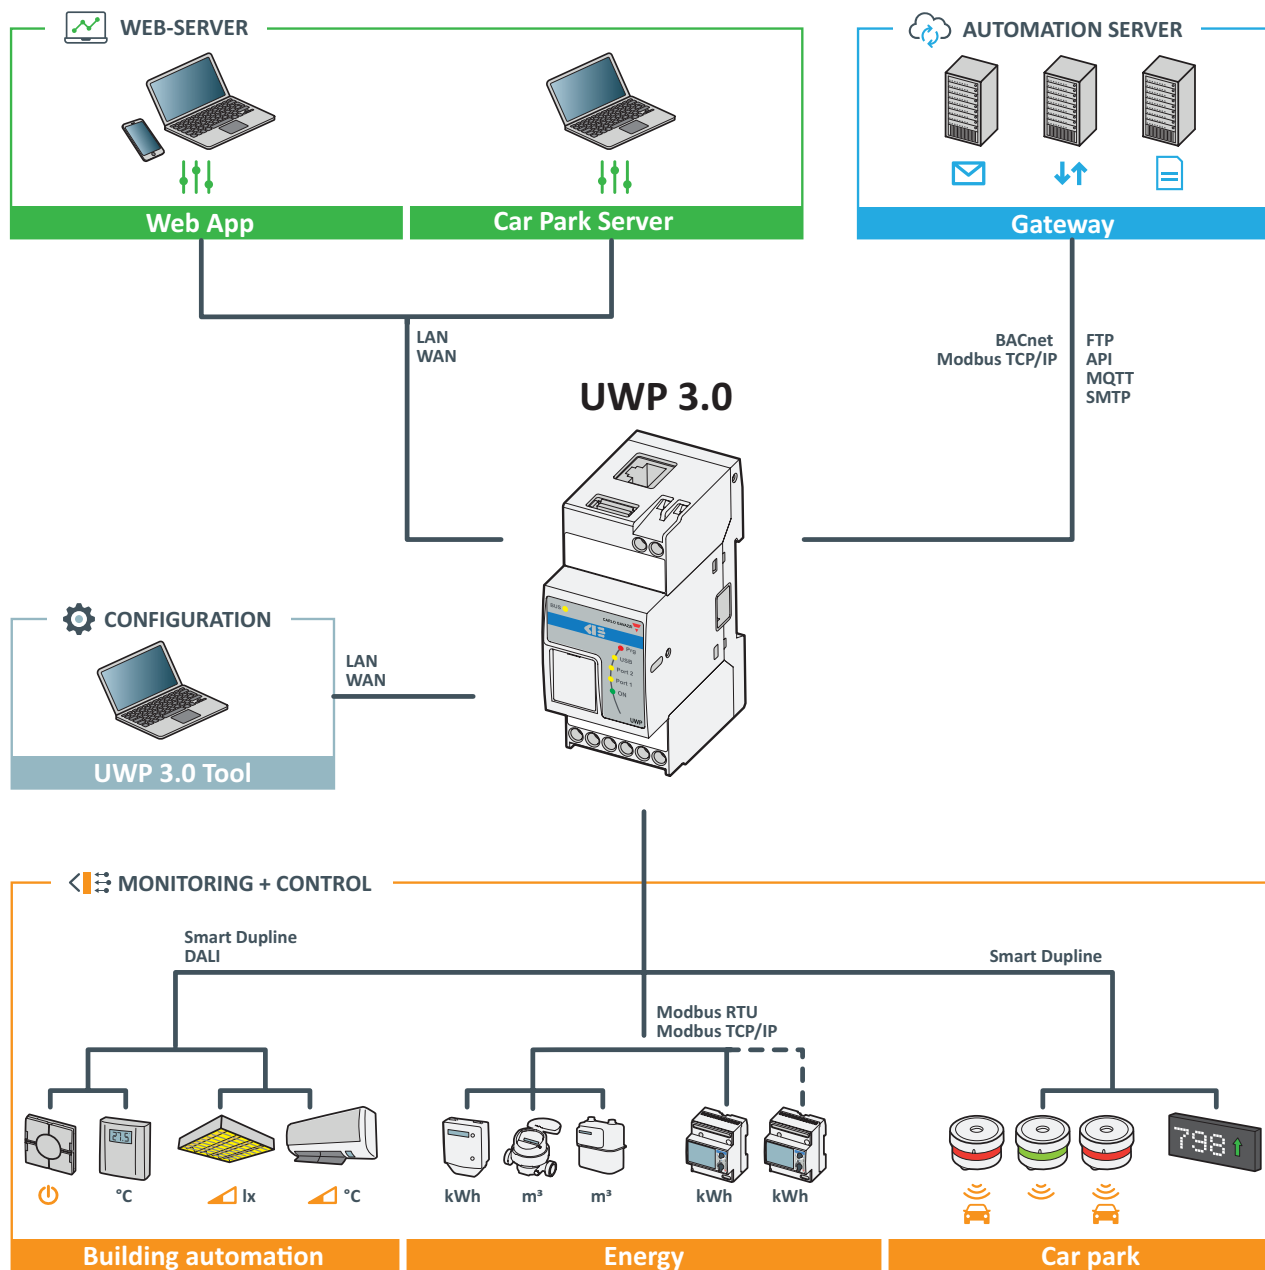

## Structure

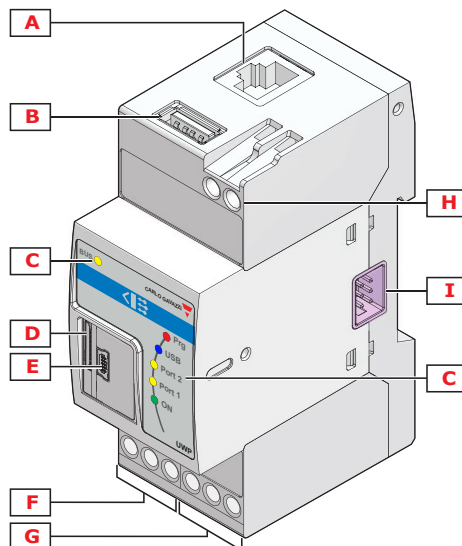


Area	Description
A	Ethernet port
B	USB port (host function)
C	Indication LEDs:
	<b>Green (ON)</b> ON - Power ON OFF - Power OFF
	<b>Yellow (BUS)</b> ON - Communication ON on the HS-bus OFF - No communication is present on the HS-bus Flashing - Communication error on the HS-bus
	<b>Yellow (Port 1)</b> OFF - Communication disabled Flashing 200 ms ON, 600 ms OFF - No communications on RS485 COM1 Flashing 200 ms ON, 200 ms OFF - Communications OK
	<b>Yellow (Port 2)</b> OFF - Communication disabled Flashing 200 ms ON, 600 ms OFF - No communications on RS485 COM2 Flashing 200 ms ON, 200 ms OFF - Communications OK
	<b>Blue (USB)</b> ON - USB device is present OFF - No USB device is present
	<b>Red (Prg)</b> ON - No configuration is present OFF - Configuration present in the UWP Flashing - UWP is connected to the UWP 3.0 Tool
D	Micro SD memory card slot
E	Mini-USB port (Device function)
F	RS485 COM1 port terminals
G	RS485 COM2 port terminals
H	Power supply connection block
I	Local bus ports (left side and right side)

## Features

### General

<b>Material</b>	Noryl, self-extinguishing V-0 (UL94)
<b>Dimensions</b>	2-DIN module
<b>Weight</b>	150 g
<b>Protection degree</b>	Front: IP40; Screw terminals: IP20
<b>Dielectric strength</b>	4000 VAC RMS for 1 minute
<b>Rejection (CMRR)</b>	>65 dB, from 45 to 65 Hz
<b>Terminals</b>	8 terminals, screw-type; Section: 1.5 mm <sup>2</sup> maximum; Torque: from 0.4 to 0.8 Nm

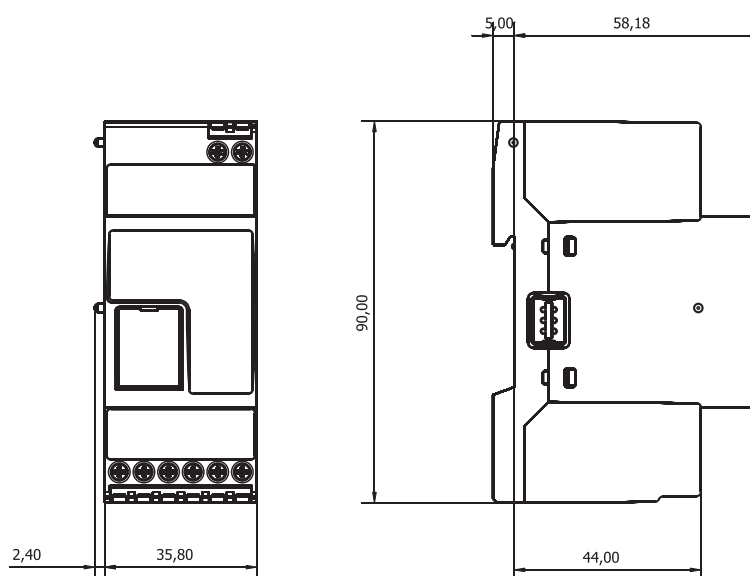

### Environmental

<b>Operating temperature</b>	-20° to +50°C (-4° to 122°F)
<b>Storage temperature</b>	-30° to +70°C (-22° to +158°F)
<b>Humidity (non-condensing)</b>	20 to 90% RH

### Power Supply




<b>Power supply</b>	15-28 VDC
<b>Consumption</b>	≤ 5 W

## Inputs/outputs insulation

Type of input/output	DC power supply	RS485 COM1	RS485 COM2	Ethernet	USB port "H"	USB port "D"	SH2UMMF124 and SH2DSP24
DC power supply	-	2 kV	2 kV	0.5 kV	0 kV	0 kV	0 kV
RS485 COM1	2 kV	-	0.5 kV	2 kV	2 kV	2 kV	2 kV
RS485 COM2	2 kV	0.5 kV	-	2 kV	2 kV	2 kV	2 kV
Ethernet	0.5 kV	2 kV	2 kV	-	0.5 kV	0.5 kV	0.5 kV
USB port "H"	0 kV	2 kV	2 kV	0.5 kV	-	0 kV	0 kV
USB port "D"	0 kV	2 kV	2 kV	0.5 kV	0 kV	-	0 kV
SH2DSP24	0 kV	2 kV	2 kV	0.5 kV	0 kV	0 kV	-

- **0kV:** inputs / outputs are not insulated.
- **2kVrms:** EN61010-1, IEC60664-1 - over-voltage category III, pollution degree 2, double insulation on systems with max. 300Vrms to ground.
- **0.5kVrms:** the insulation is functional type Mounting.

## Compatibility and conformity

Standards	Electromagnetic compatibility (EMC) - immunity: EN61000-6-2
	Electromagnetic compatibility (EMC) - emissions: EN61000-6-3
	Safety: EN60950
Directives	EMC 2014/30/EU LVD 2014/35/EU RoHS 2011/65/EU
Approvals	  

## Ports

### Ethernet

<b>Standard</b>	ISO9847
<b>LAN Configuration</b>	Static or DHCP IP Address; Net Mask; Default Gateway, DNS (primary, secondary)
<b>DYNDNS</b>	dyndns.it, dyndns.org, freedns.afraid.com, zoneedit.com, no-ip.com, easydns.com, 3322.org, sitelution.com, dnsomatic.com, tunnelbroker.net, tzo.com, dhis.com
<b>Protocols</b>	HTTP, HTTPS, FTP, FTPS, SFTP, Modbus TCP/IP, DP (Data Push), SMTP, NTP, Azure IoT Hub, Modbus Gateway TCP/RTU, BACnet IP
<b>Client connections</b>	WEB server: Port: 80; 5 connections TOOL: 1 connection Modbus TCP/IP: 5 connections
<b>Connection type</b>	RJ45 connector (10 Base-T, 100 Base-TX); maximum distance: 100m

### RS485

<b>Number of ports</b>	2
<b>Function</b>	COM1: Master or slave (gateway function) COM2: Master
<b>Number of slaves</b>	COM1: up to 64 COM2: up to 64
<b>Connections</b>	2-wire. Max. distance 600 m
<b>Protocol</b>	Modbus RTU
<b>Data format</b>	Selectable: 1 start bit, 7/8 data bit, no/odd/even/ parity, 1/2 stop bit
<b>Baud-rate</b>	Selectable: from 110 to 256000 bits/s
<b>Driver input capability</b>	1/8 unit load Up to 256 nodes on a network

### USB

<b>Type</b>	Hi-speed 2.0 Type-A
<b>Mode</b>	Host
<b>Communication speed</b>	60MB/s
<b>Function</b>	Setting IP
<b>Supported Device Type</b>	USB mass storage: direct connection to UWP 3.0 USB modem/router: via additional module SH2DSP24
<b>Supported File System</b>	FAT32, ext2, ext3, ext4
<b>Note</b>	Disabled automatically when SH2DSP24 is connected

### Mini-USB

<b>Type</b>	Hi-speed 2.0 mini-B
<b>Mode</b>	Device
<b>Speed</b>	60 MB/s
<b>Function</b>	RNDIS (Virtual Ethernet) Network Access via IP: 192.168.254.254

### Micro SD slot

<b>Type</b>	Industrial (from -25 to +85 °C / -13 to + 185 °F)
<b>Capacity</b>	SD and SDHC Up to 32 GB
<b>Function</b>	Setting IP
<b>Supported File System</b>	FAT32,ext2,ext3,ext4

### HS Bus

<b>Bus type</b>	RS485 high speed bus
<b>Function</b>	Connection to master channel generator modules (SH2MCG24, SH2WBU230x, SH2DUG24 and SBP2MCG324)
<b>Number of slaves</b>	Maximum 7
<b>Connection</b>	By local bus on the right hand side Note: All the SH2MCG24, SH2WBU230x, SH2DUG24 and SBP2MCG324 modules have to be connected on the right hand side of the SH2WEB24.
<b>Terminalisation</b>	Always required on the last module
<b>Max distance</b>	600 m



## TCP/IP Ports

### Inbound communication

Port number	Description	Purpose
80	HTTP	Access to the internal web-server, API functions
443	HTTPS	Access to the internal web-server, API functions
52325	SSH	Remote service (reserved to support personnel)
10000	UWP 3.0	Configuration and maintenance (UWP 3.0 Tool)
10001	UWP 3.0	Configuration and maintenance (UWP 3.0 Tool)
10002	UWP 3.0	Configuration and maintenance (UWP 3.0 Tool)

### Outbound communication

Port number	Description	Purpose
53	DNS	Domain name resolution
123	NTP	Network time services access
21	FTP	Data upload to FTP server
25	SMTP	Email message dispatching
80	HTTP	DP (data push communication)

### Modbus TCP/IP

Function	TCP Port	Purpose
Modbus TCP/IP Slave	502 (selectable)	Modbus TCP data communication
Modbus bridge TCP/RTU	503 (selectable)	Bridge function for accessing (read and write) RTU meter connected to the UWP RTU ports

## Data management

<b>Multi-BUS communication</b>	INPUT from: Modbus RTU, Modbus TCP/IP, Dupline OUTPUT to: Modbus RTU, Modbus TCP/IP, BACnet, Dupline, DALI
<b>Embedded Database</b>	Embedded database for storing system configuration, variables, events Flexible data model based on signals definition and functions creation
<b>Automation server</b>	Automation server for exchanging data with other systems via: FTP, SFTP, FTPS, Rest-API, SMTP, MQTT


# Functions

## Local monitoring and control

<b>Connectable devices</b>	Carlo Gavazzi Meters Smart Dupline sensors and actuators BACnet masters Modbus RTU, Modbus TCP/IP slaves (any Modbus slave can be integrated thanks to the Free Modbus Editor tool)
<b>Monitoring functions</b>	Logging of variables and events Average, Maximum, Minimum calculation Creation of triggers based on events
<b>User Interface functions</b>	Responsive web interface Customised dashboards Charting tools for displaying and analysing history data Cost centres base navigation tree Energy Summary display Dedicated widgets for monitoring control functions
<b>Automation Server functions</b>	M2M communication via: Rest-API, FTP, SFTP, FTPS, MQTT, SMTP, Modbus TCP/IP, BACnet Email or SMS alerts Multi-site data aggregation via Em <sup>2</sup> -Server Microsoft Azure certified for IoT Amazon AWS IoT compatible
<b>Reporting</b>	Online or scheduled reports in XLSX, XML, CSV format XLSX report templates with free variable selection

## Local control

<b>Connectable devices</b>	Carlo Gavazzi Meters Smart Dupline sensors and actuators Modbus RTU, Modbus TCP/IP slaves and DALI ballasts
<b>Control functions</b>	ON/OFF switching Standard Light Control functions, including DALI and dimming Advanced Light Control, including Tunable White Control and Constant Light Temperature control Roller Blind control BMS integration via Modbus TCP/IP and BACnet Logic functions, timers, analog comparators Calendar scheduler Math function Analogue (0-10 V) Output Smoke, Water, Intruder alarms Astronomical clock Hour counter Commands over Modbus Modbus driver writing / reading functions for any Modbus device
<b>User Interface functions</b>	Responsive web interface Customised dashboards Dedicated widgets for monitoring control functions and events
<b>Automation Server functions</b>	Integration into BMS systems via BACnet and Modbus TCP/IP Email or SMS alerts
<b>Reporting</b>	Online or scheduled reports in XLSX, XML CSV format for events

 **Car parking guidance**


<b>Connectable devices</b>	Carlo Gavazzi Car Park sensors and actuators
<b>Control functions</b>	Car Park Guidance
<b>User Interface functions</b>	Responsive web interface Real time Car Park zones/bays mapping Analysis of historical occupation Commands and indicators display
<b>Automation Server functions</b>	Scalability via Carlo Gavazzi CPY system

# Software and interfaces

## UWP 3.0 Tool

UWP 3.0 Tool is the UWP 3.0 configuration software. It allows the user to:

- carry out the system commissioning
- define the automation and control logics
- set the measuring instruments and sensors monitoring.

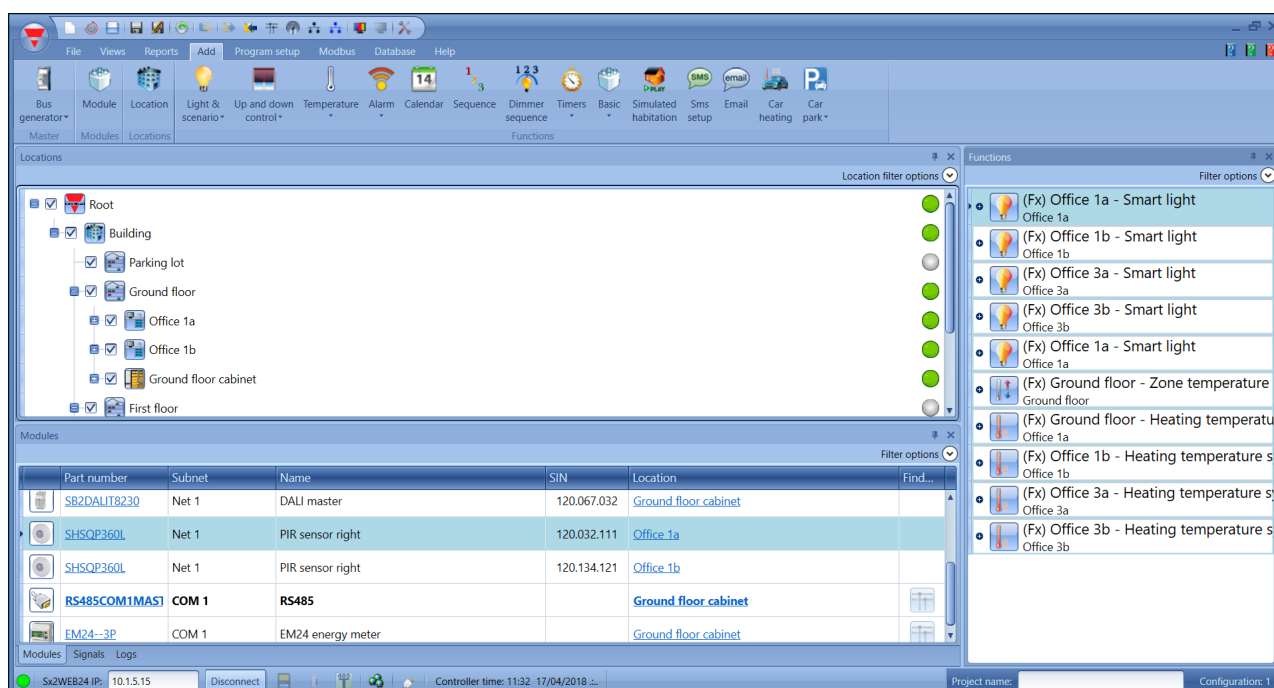


### Main functions

- To configure interfaces and communication protocols
- To execute the Dupline modules automatic scan for fast commissioning
- To configure and manage the connected modules
- To define the control and automation functions
- To generate a driver to monitor third party Modbus devices
- To set the data and events collection and storage from Carlo Gavazzi or third party instruments
- To configure the Carlo Gavazzi Car Park system
- To setup the Carpark devices (sensors, indicators, displays)
- To develop Modbus drivers for UWP 3.0 with both reading and writing functions for any Modbus device
- To save a configuration offline for backup or any subsequent use

## UWP 3.0 Web App

The UWP 3.0 Web App is the UWP 3.0 Web Interface, accessible through Web browsers from mobile or desktop devices. Through widgets contained in predefined and customised dashboards, it allows the user to:

- view and export collected data
- control the automation functions
- define specific settings (User Interface and Server Automation).

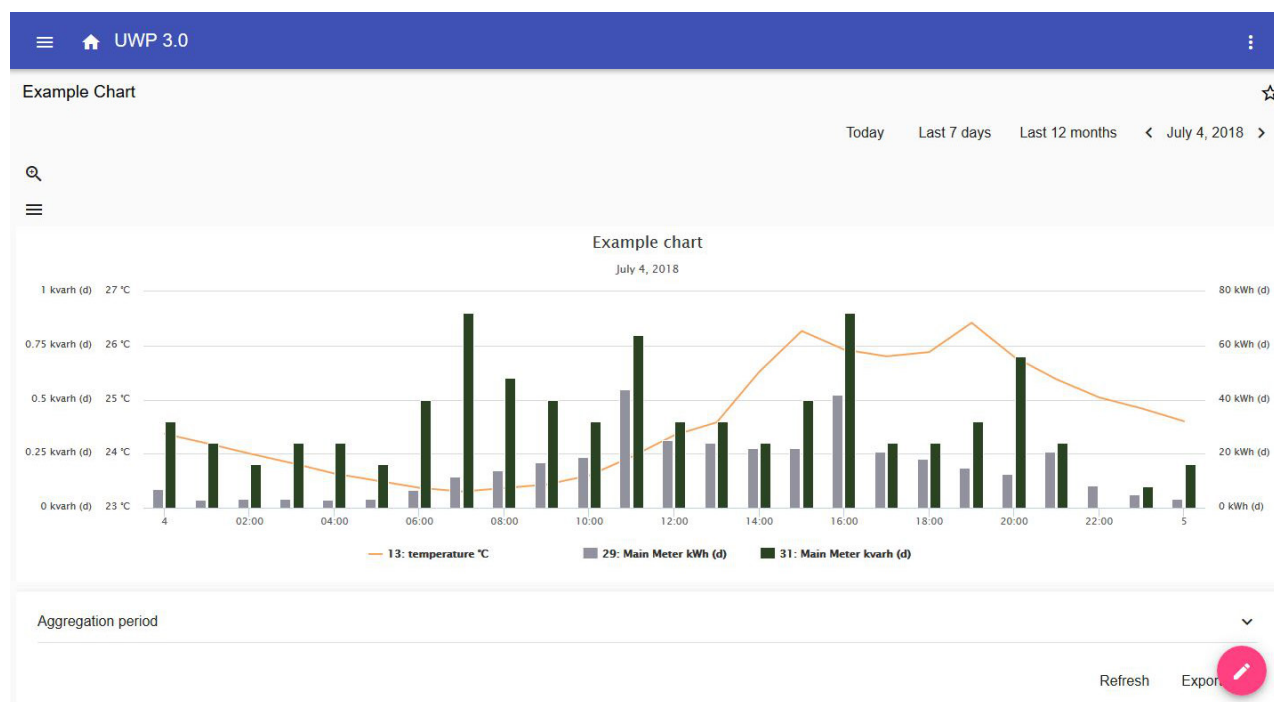

### Main functions

- To view collected data as real time values or charts
- To generate data and events reports
- To manage and adjust the functions parameters (for example, modify temperature set points)
- To send commands (for example, switching on/off or select scenarios)
- To configure Data Push Services to FTP/SFTP/FTPS servers or Em<sup>2</sup>-Server (Carlo Gavazzi)
- To configure MQTT link to IoT Hubs (Amazon AWS and Microsoft Azure).

# Car Park Server

The Car Park solution includes the setup of the system and the monitoring of the installation. It allows the user to:

- define the configuration of the user interface
- view and export statistics for the car park occupancy.




## Main functions

- To collect data from ultrasonic sensors
- To elaborate statistics: real time and historical occupation data from groups of sensors or single bays
- To command displays and indicators
- To represent data using with real time maps on the built-in car park web server
- To set the zone counter function for rooftop car park control or complete indoor/outdoor monitoring.

Note: The Car Park and the Data Push (to Em<sup>2</sup>-Server and IoT Hubs) functions can not be used concurrently.



# Connection Diagrams

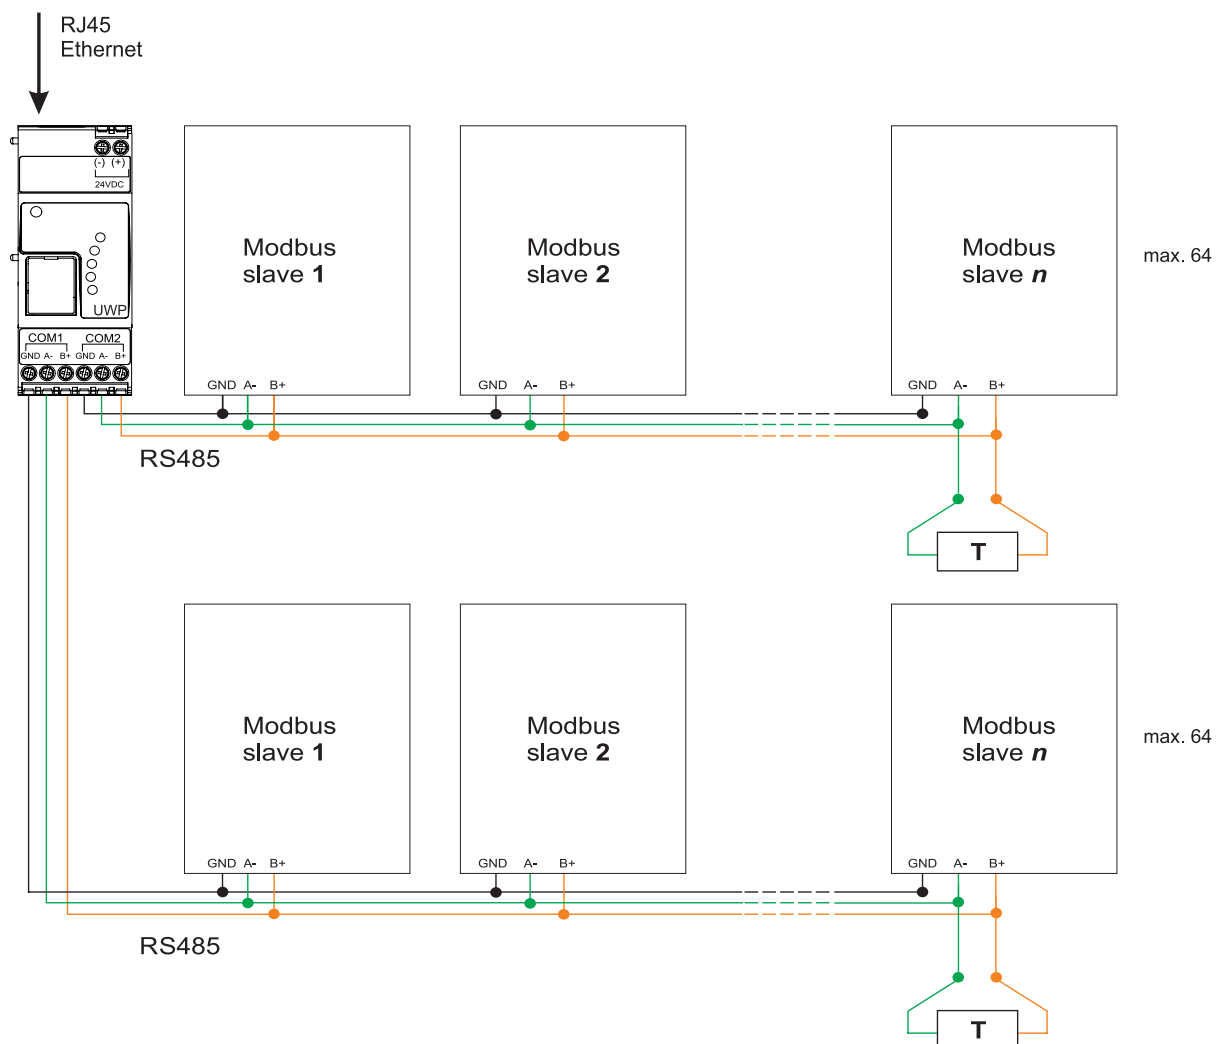

**Fig. 1** Modbus RTU connection. COM 1 master, COM 2 master

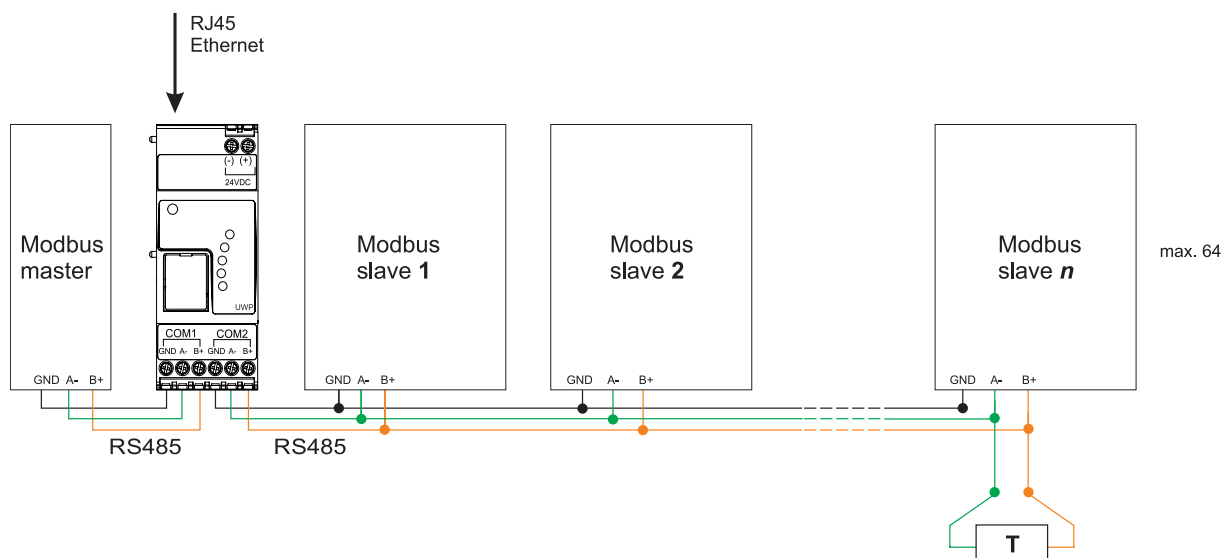


Fig. 2 Modbus RTU connection. COM 1 slave, COM 2 master

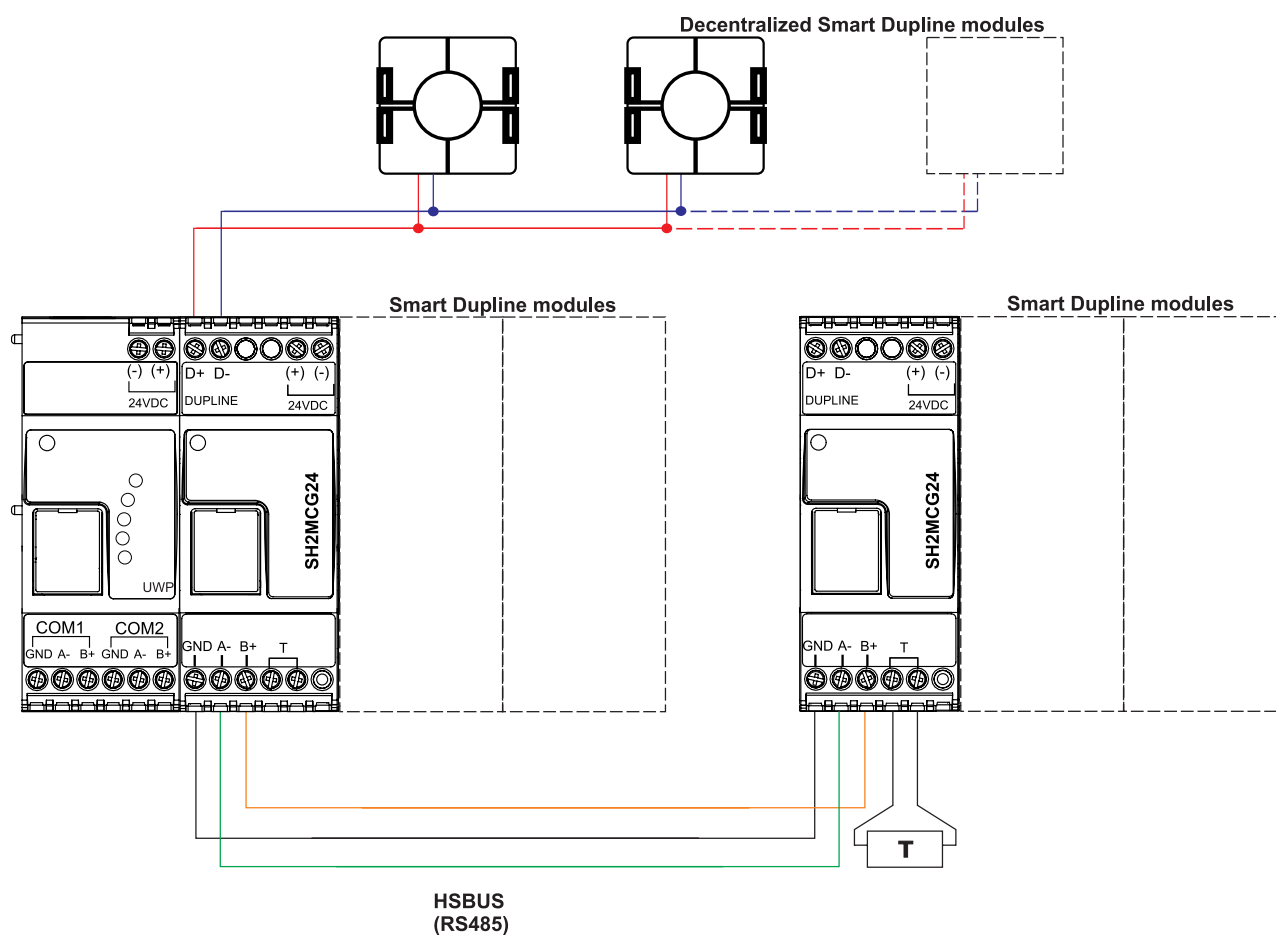


Fig. 3 Example of Smart Dupline modules connection using master channel generators






Fig. 4 Power supply

## References

### Further reading

Information	Document	Where to find it
Hardware manual	UWP 3.0 HW manual	<a href="http://www.productselection.net/MANUALS/UK/uwp3.0_system.pdf">www.productselection.net/MANUALS/UK/uwp3.0_system.pdf</a>
Software manual	UWP 3.0 Tool manual	<a href="http://www.productselection.net/MANUALS/UK/uwp3.0_tool.pdf">www.productselection.net/MANUALS/UK/uwp3.0_tool.pdf</a>
Wireless manual	UWP 3.0 wireless installation manual	<a href="http://www.productselection.net/MANUALS/UK/uwp3.0_wireless.pdf">www.productselection.net/MANUALS/UK/uwp3.0_wireless.pdf</a>
White paper	UWP 3.0 for Azure IoT- whitepaper	<a href="http://www.productselection.net/Pdf/UK/CGC-W-EE-IoT-002.pdf">www.productselection.net/Pdf/UK/CGC-W-EE-IoT-002.pdf</a>
Web App manual	UWP 3.0 Web App - Instruction manual	<a href="http://www.productselection.net/MANUALS/UK/uwp3.0_web_app_eim.pdf">www.productselection.net/MANUALS/UK/uwp3.0_web_app_eim.pdf</a>



### UWP30RSEXXX

### How to order

Information	Document	Where to find it
UWP 3.0 How to order	How to order	<a href="http://www.productselection.net/DOCUMENT/UK/UWP3_how_to_order.pdf">www.productselection.net/DOCUMENT/UK/UWP3_how_to_order.pdf</a>



COPYRIGHT ©2019

Content subject to change.

DOWNLOAD THE UPDATED VERSION: [www.productselection.net/PDF/UK/uwp3.0.pdf](http://www.productselection.net/PDF/UK/uwp3.0.pdf)

## X-ON Electronics

Largest Supplier of Electrical and Electronic Components

*Click to view similar products for [Controllers](#) category:*

*Click to view products by [Carlo Gavazzi](#) manufacturer:*

Other Similar products are found below :

[CS1WCN223](#) [CS1WCN713](#) [CS1WKS001E](#) [61F-11NH](#) [61FGPN8DAC120](#) [61F-GP-NT AC110](#) [61F-GPN-V50-AC110](#) [70177-1011](#) [F03-03](#)  
[HAS B](#) [F03-03 HAS C](#) [F03-31](#) [81513201](#) [81513535](#) [81550401](#) [FT1A-C12RA-W](#) [88981106](#) [H2CAC24A](#) [R88A-CAGA005S](#) [R88A-](#)  
[CRGB003CR-E](#) [R88ARR080100S](#) [R88A-TK01K](#) [DCN1-1](#) [DTB4896VRE](#) [DTB9696CVE](#) [DTB9696LVE](#) [MR-50LF+](#) [E53-AZ01](#) [E53E8C](#)  
[E5CWLQ1TCAC100240](#) [B300LKL21](#) [NE1ASCPU02EIPVER11](#) [NE1SCPU01](#) [NE1SDRM21U](#) [NSCXDC1V3](#) [NSH5-232CW-3M](#)  
[NT20SST122BV1](#) [NV3Q-SW41](#) [NV4W-ATT01](#) [NV-CN001](#) [OAS-160-N](#) [K31S6](#) [K33-L1B](#) [K3TX-AD31A](#) [L595020](#) [SRS2-1](#) [G32X-V2K](#)  
[26546803](#) [26546805](#) [26546831](#) [CJ1W-OD204](#)