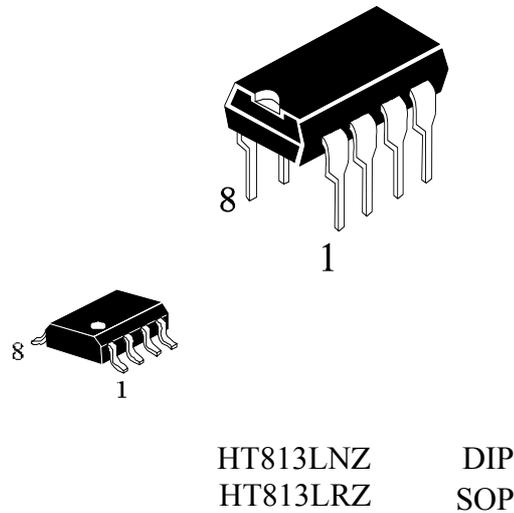


Threshold 4.65V low power microprocessor reset circuit

HT813L microcircuit is purposed to check power supply and to start up microcontroller and microprocessor systems. It is applied to ensure regular standard operation of the circuit when the device is switched on/off and also when there is alarm emergency dropping of supply voltage.

Physically the microcircuit is made in 8-pin DIP & SO packages



Features

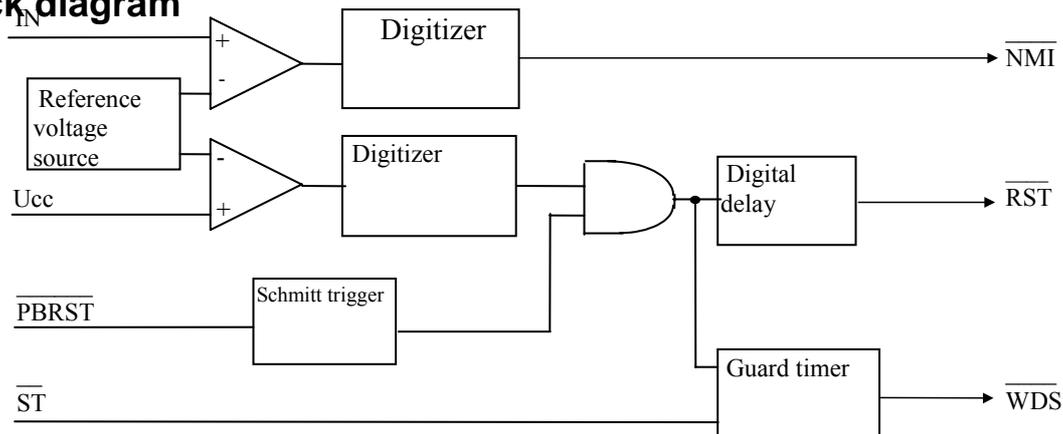
- Standard supply voltage 5,0 V
- Operation temperature range $T_A =$ from -40°C to $+85^{\circ}\text{C}$
- RESET signal generation when power supply is provided for regular start-up of microprocessor
- RESET signal generation when power supply is dropped below operation one to exclude incorrect operation of microprocessor.
- RESET signal generation when reset key is pressed
- Option of threshold voltage programming when RESET signal is generated

Microcircuit includes:

- reference voltage source
- two analog comparators
- guard timer
- digitizer, (digital sampler)
- digital delay

Functions performed

- RESET signal generation by fixed supply voltage level
- RESET signal generation from external RESET key
- Generation of guard timer state signal
Alarm interrupt of host power supply

Block diagram

Pin description

Pin	Symbol	Name	Type
01	$\overline{\text{PBRST}}$	Push button Reset	Input
02	V_{CC}	Supply voltage	-
03	GND	Common pin	-
04	IN	input	Input
05	$\overline{\text{NMI}}$	Non-masked interrupt	Output
06	$\overline{\text{ST}}$	Strobe input	Input
07	$\overline{\text{RST}}$	Reset low reset	Output
08	$\overline{\text{WDS}}$	Watchdog status	Output

Operation temperature range

Operation temperature range от -40°C до $+85^{\circ}\text{C}$.

MAXIMUM RATINGS*

Parameter, unit	Symbol	Recommended modes		Absolute maximum ratings	
		min	max	min	max
Supply voltage, V	V_{CC}	1.2*	5.5	-0.5	7.0
High level input voltage, V, $\overline{\text{ST}}$, $\overline{\text{PBRST}}$ inputs $V_{CC} \geq 2.4\text{ V}$ $V_{CC} < 2.4\text{ V}$	V_{IH}	2.0 $V_{CC} - 0.5$	$V_{CC} + 0.3$	-	$V_{CC} + 0.5$
Low level input voltage, V	V_{IL}	-0.03	0.5	-0.5	-
Temperature range, $^{\circ}\text{C}$	T_a	-40	85	-60	+125

* In the case supply voltage decreased down to 1,2V $\overline{\text{RST}}$ kept in active low state

Electric features

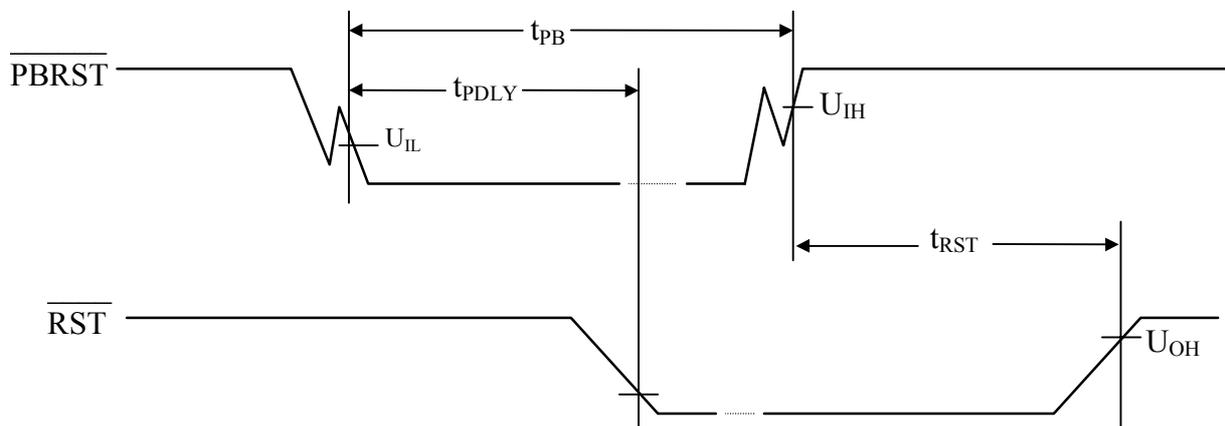
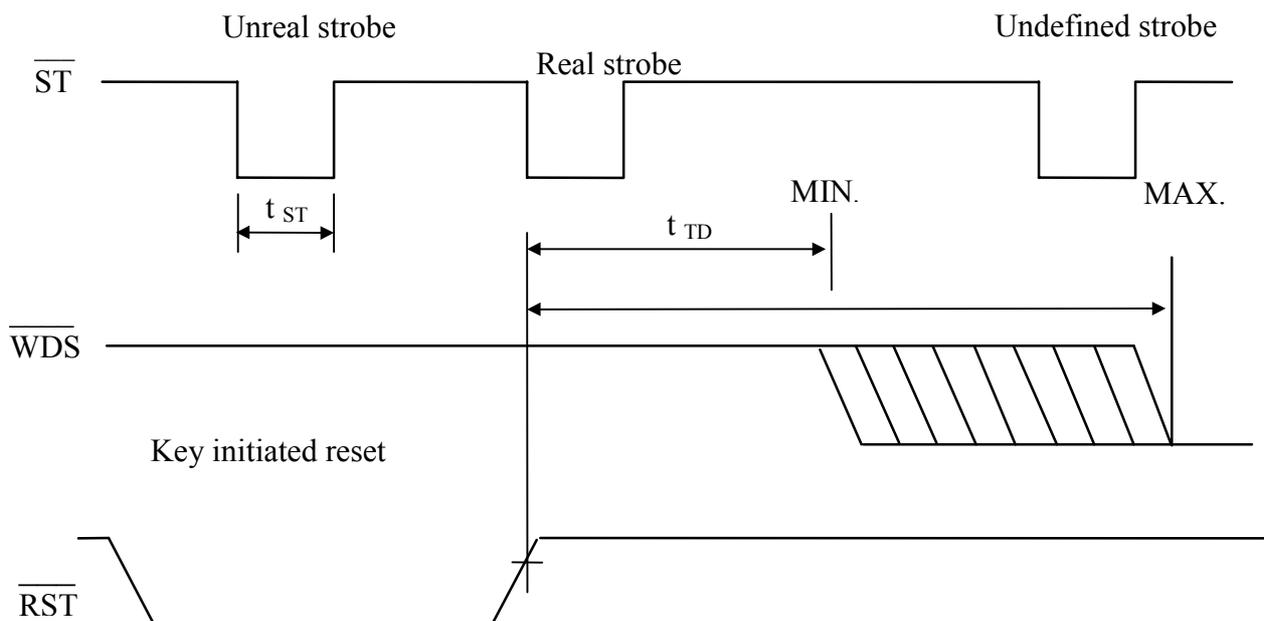
Parameter, unit	Symbol	Mode	Norm		Temperature, °C
			min	max	
Low level leakage current on IN, uA	I_{LIL1}	$V_{CC} = 5.5 \text{ B}$	–	-1.0	25 ± 10; -40; 85
Low level leakage current on $\overline{\text{PBRST}}$, uA	I_{LIL2}	$V_{CC} = 5.5 \text{ B}$	-50	-450	
Low level leakage current on $\overline{\text{ST}}$, uA	I_{LIL3}	$V_{CC} = 5.5 \text{ B}$	-10	-100	
High level leakage current on IN, $\overline{\text{ST}}$, $\overline{\text{PBRST}}$ inputs, uA	I_{LIH}	$V_{CC} = 5.5 \text{ B}$	–	1.0	
Consumption current, uA	I_{CC}	$V_{CC} = 5.5 \text{ B}$	–	60	
		$V_{CC} = 3.6 \text{ B}$		50	
Low level output current, mA	I_{OL}	$V_{CC} \geq 2.4 \text{ B}$ $V_{OL} = 0.4 \text{ B}$	10	–	
High level output voltage, B	V_{OH}	$V_{CC} \geq 2.4 \text{ B}$ $I_{OH} = -500 \text{ mA}$	$V_{CC} - 0.3$	–	
V_{CC} trip point, V	V_{CCTP}	–	2.85	3.0	
In input trip point	V_{TP}	$V_{CC} = 5.0 \text{ B}$	1.2	1.3	
Set up time of Reset on $\overline{\text{PBRST}}$ signal, ns	t_{PDLY}	$V_{CC} = 5.0 \text{ B}$ $t_{PB} \geq 150 \text{ ns}^*$	–	250	
Hold on time of Reset on $\overline{\text{PBRST}}$ signal, ns	t_{RST}	$V_{CC} = 5.0 \text{ B}$ $t_{PB} \geq 150 \text{ ns}^*$	130	285	
Hold on time of Reset on, V_{CC} , ms	t_{RPU}	$V_{CC} = 5.0 \text{ B}$	130	285	
Watch dog time out	t_{TD}	$V_{CC} = 5.0 \text{ B}$ $t_{ST} \geq 10 \text{ ns}^{**}$	1.0	2.2	

* t_{PB} – low level signal duration on $\overline{\text{PBRST}}$

** t_{ST} – low level signal duration on $\overline{\text{ST}}$

Dynamic parameters
 U_{CC} = from 4,5 to 5,5V, T_A = from -40° to +85°C

Parameter symbol	Name	Norm		Unit
		not less	not more	
t_{TD}	Guard timer reflow time	1,0	2,2	s
t_{PDLY}	Setting time for reset by PBRST signal	-	250	ns
t_{RST}	Reset hold-in time by PBRST signal	130	285	ms
t_{RPD}	Setting time for reset by U_{CC}	-	8,0	mks
t_{RPU}	Hold-in time for reset by U_{CC}	130	285	ms
t_{IPD}	Interrupt setting time for IN input	-	8,0	mks
t_{PB}	Key press duration (PBRST = U_{IL})	150	-	ns
t_{ST}	Strobe pulse width	10	-	ns

Time diagrammes

Fig.1 - Time diagramme of generation guard timer state signal.

Fig.2 - Time diagramme of generation guard timer state signal (strobed input)

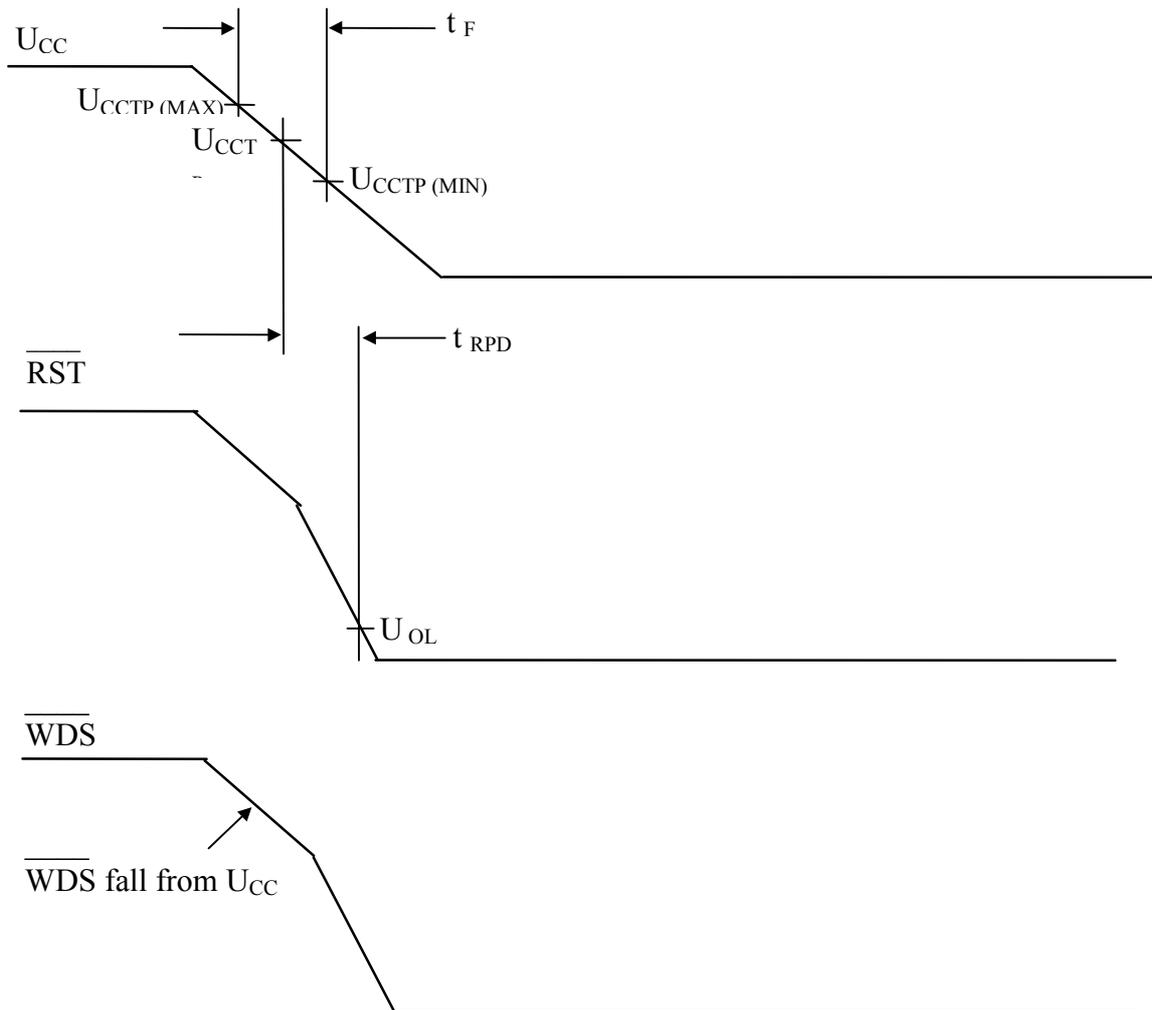


Fig. 3 - Time diagram of generation reset signal when power supply is dropped up to U_{strobe} (power supply error)

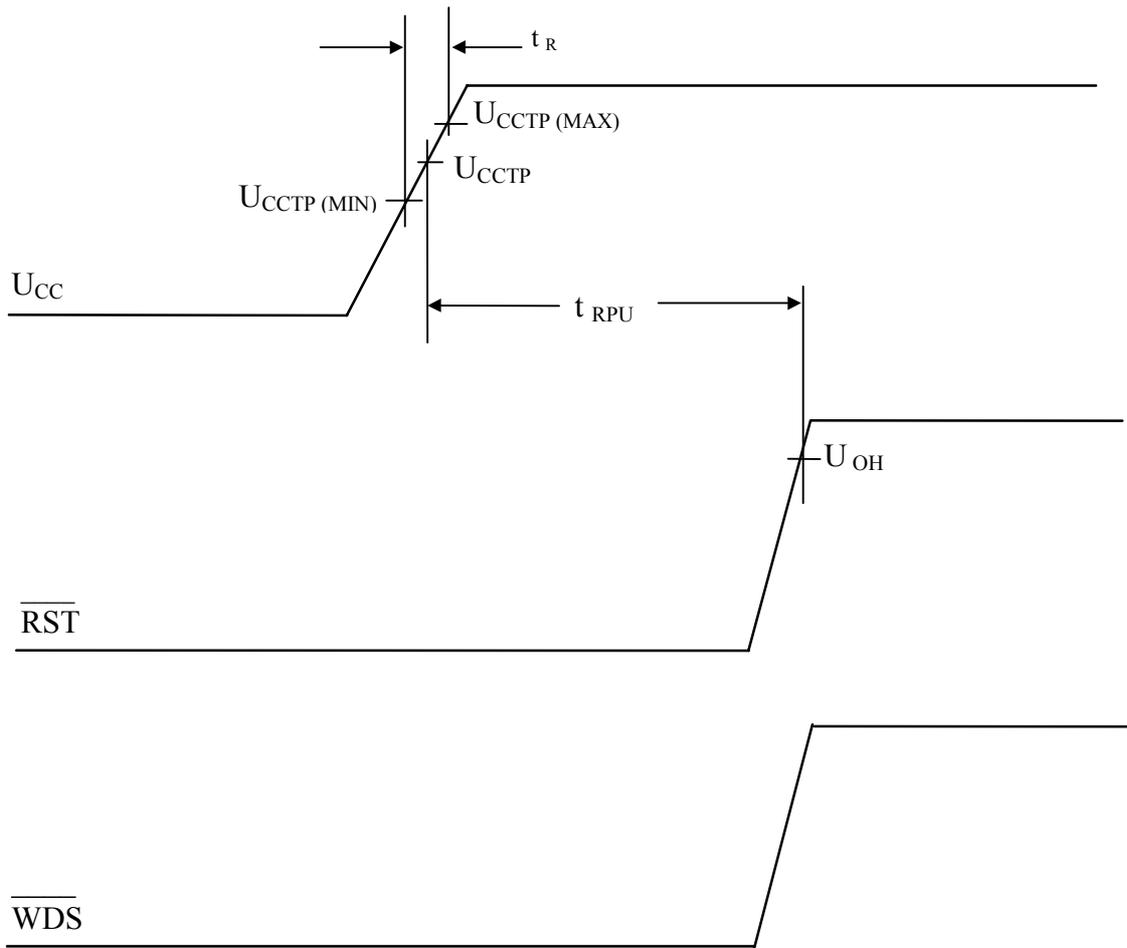


Fig. 4 - Time diagramme fo power supply connection (reset signal is reset active after power supply is transferred to stable state)

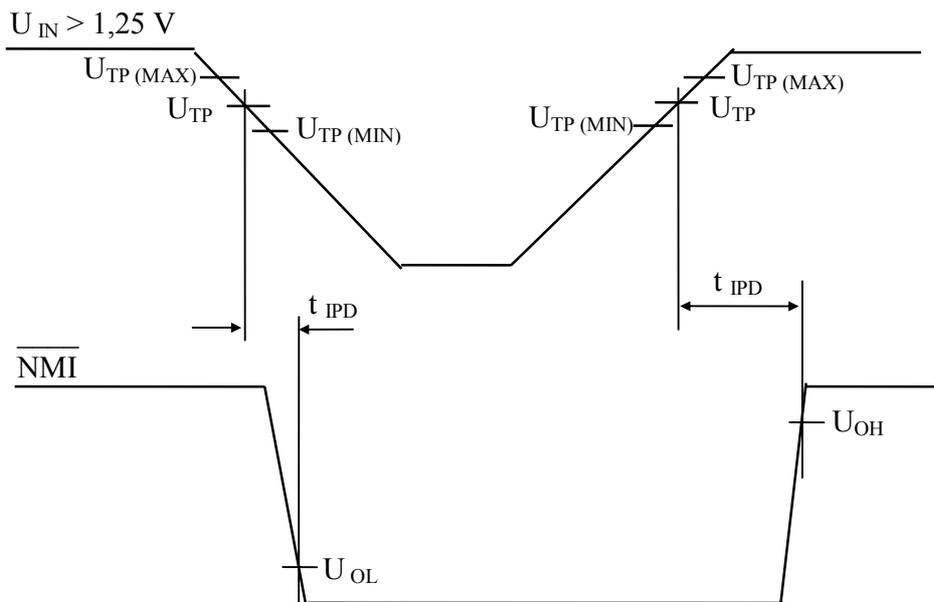


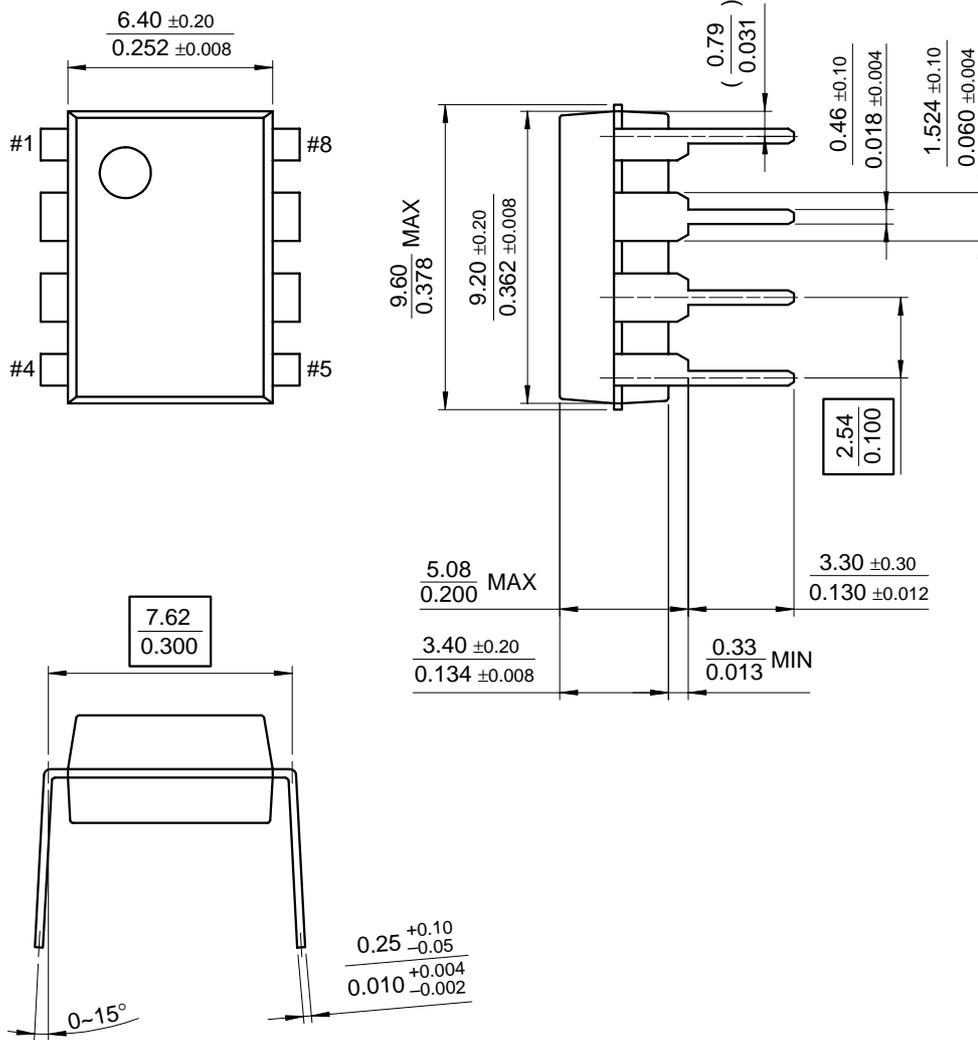
Fig. 5 - Time diagrammed of non-masked interrupt.

Mechanical Dimensions

Package

Dimensions in millimeters

8-DIP

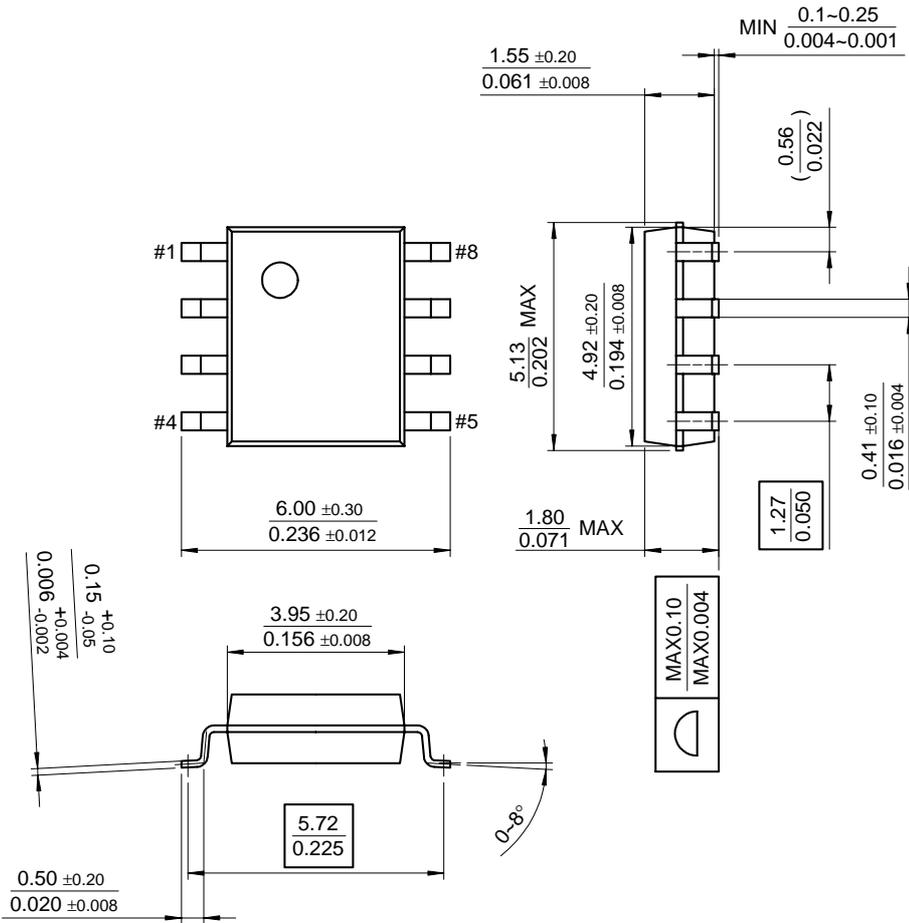


Mechanical Dimensions (Continued)

Package

Dimensions in millimeters

8-SOP



X-ON Electronics

Largest Supplier of Electrical and Electronic Components

Click to view similar products for [Supervisory Circuits](#) category:

Click to view products by [HTCSEMI](#) manufacturer:

Other Similar products are found below :

[NCP304LSQ40T1G](#) [CAT1161LI-25-G](#) [CAT853STBI-T3](#) [MCP1316MT-45GE/OT](#) [MCP1316MT-23LI/OT](#) [MCP1316T-26LE/OT](#) [DS1232L](#)
[NCV302HSN45T1G](#) [PT7M6130NLTA3EX](#) [S-1000N28-I4T1U](#) [CAT1161LI-28-G](#) [MCP1321T-29AE/OT](#) [MCP1320T-31KE/OT](#) [S-1000N23-I4T1U](#) [S-1000N19-I4T1U](#) [CAT824UTDI-GT3](#) [TC54VC2502ECB713](#) [MCP1317T-25LE/OT](#) [PT7M6133NLTA3EX](#) [PT7M6127NLTA3EX](#)
[BD48E23G-TR](#) [BD48E49G-TR](#) [BD48E52G-TR](#) [MP6412GQGU-Z](#) [XC61GN2502HR-G](#) [MB3793-37APNF-G-JN-ER6E1](#) [CPC5712U](#)
[LTC693CSW](#) [TC1232EOE](#) [TC1270ALVRCTR](#) [TC1270ANTVRCTR](#) [TC1271MERCCTR](#) [TC32MEZB](#) [TC54VN2102ECB713](#) [MB3793-27DPNF-G-JN-ERE1](#) [MCP100-460HITO](#) [MCP100-475HI/TO](#) [MCP100-485DI/TO](#) [MCP101-460HI/TO](#) [MCP101-475HI/TO](#)
[TCM809LVLB713](#) [TCM809SVLB713](#) [TCM810RVLB713](#) [MCP102-315E/TO](#) [MCP103T-300ELB](#) [MCP111-475E/TO](#) [MCP111T-300E/LB](#)
[MCP120-450HI/TO](#) [MCP120-475GITO](#) [MCP120-485DI/TO](#)