



**EN** Operating instructions. . . . .pages 1 to 6  
Original

**Content**

**1 About this document**

1.1 Function . . . . . 1

1.2 Target group: authorised qualified personnel. . . . . 1

1.3 Explanation of the symbols used . . . . . 1

1.4 Appropriate use . . . . . 1

1.5 General safety instructions . . . . . 1

1.6 Warning about misuse . . . . . 2

1.7 Exclusion of liability . . . . . 2

**2 Product description**

2.1 Ordering code . . . . . 2

2.2 Special versions. . . . . 2

2.3 Destination and use . . . . . 2

2.4 Technical data . . . . . 2

2.5 Safety classification . . . . . 3

**3 Mounting**

3.1 General mounting instructions . . . . . 3

3.2 Dimensions . . . . . 3

**4 Electrical connection**

4.1 General information for electrical connection. . . . . 3

**5 Operating principle and settings**

5.1 LED functions. . . . . 3

5.2 Description of the terminals . . . . . 3

**6 Set-up and maintenance**

6.1 Functional testing. . . . . 4

6.2 Maintenance . . . . . 4

**7 Disassembly and disposal**

7.1 Disassembly. . . . . 4

7.2 Disposal . . . . . 4

**8 Appendix**

8.1 Wiring example . . . . . 4

**9 EU Declaration of conformity**

**1. About this document**

**1.1 Function**

This operating instructions manual provides all the information you need for the mounting, set-up and commissioning to ensure the safe operation and disassembly of the safety-monitoring module. The operating instructions must be available in a legible condition and a complete version in the vicinity of the device.


**1.2 Target group: authorised qualified personnel**


All operations described in this operating instructions manual must be carried out by trained specialist personnel, authorised by the plant operator only.


Please make sure that you have read and understood these operating instructions and that you know all applicable legislations regarding occupational safety and accident prevention prior to installation and putting the component into operation.

The machine builder must carefully select the harmonised standards to be complied with as well as other technical specifications for the selection, mounting and integration of the components.

**1.3 Explanation of the symbols used**

 **Information, hint, note:**  
This symbol is used for identifying useful additional information.

 **Caution:** Failure to comply with this warning notice could lead to failures or malfunctions.  
**Warning:** Failure to comply with this warning notice could lead to physical injury and/or damage to the machine.

 To avoid EMC disturbances, the physical ambient and operational conditions at the place where the product is installed, must meet the provisions laid down in the paragraph "Electromagnetic Compatibility (EMC)" of DIN EN 60204-1.


**1.4 Appropriate use**

The products described in these operating instructions are developed to execute safety-related functions as part of an entire plant or machine. It is the responsibility of the manufacturer of a machine or plant to ensure the correct functionality of the entire machine or plant.

The output expander module must be exclusively used in accordance with the versions listed below or for the applications authorised by the manufacturer. Detailed information regarding the range of applications can be found in the chapter "Product description".

**1.5 General safety instructions**

The user must observe the safety instructions in this operating instructions manual, the country-specific installation standards as well as all prevailing safety regulations and accident prevention rules.

 Further technical information can be found in the Schmersal catalogues or in the online catalogue on the Internet: [www.schmersal.net](http://www.schmersal.net).

The information contained in this operating instructions manual is provided without liability and is subject to technical modifications.



The entire concept of the control system, in which the safety component is integrated, must be validated to EN ISO 13849-2.

There are no residual risks, provided that the safety instructions as well as the instructions regarding mounting, commissioning, operation and maintenance are observed.

### 1.6 Warning about misuse



In case of inadequate or improper use or manipulations of the component, personal hazards or damage to machinery or plant components cannot be excluded. The relevant requirements of the standards EN 1088 and EN ISO 13850 must be observed.

### 1.7 Exclusion of liability

We shall accept no liability for damages and malfunctions resulting from defective mounting or failure to comply with this operating instructions manual. The manufacturer shall accept no liability for damages resulting from the use of unauthorised spare parts or accessories.

For safety reasons, invasive work on the device as well as arbitrary repairs, conversions and modifications to the device are strictly forbidden; the manufacturer shall accept no liability for damages resulting from such invasive work, arbitrary repairs, conversions and/or modifications to the device.

The safety-monitoring module must only be used when the enclosure is closed, i.e. with the front cover fitted.

## 2. Product description

### 2.1 Ordering code

This operating instructions manual applies to the following types:

SRB402EM <sup>①</sup>		
No.	Option	Description
①	/CC	plug-in screw terminals 0.25...2.5 mm <sup>2</sup> plug-in cage clamps 0.25 ... 1.5 mm <sup>2</sup>



This device is designed as output expander module. The safety function is only realised in conjunction with the basic device. To this effect, the device must be connected in accordance with the wiring example!

### 2.2 Special versions

For special versions, which are not listed in the order code below 2.1, these specifications apply accordingly, provided that they correspond to the standard version.

### 2.3 Destination and use

The output expander modules for integration in safety circuits are designed for fitting in control cabinets. They are used for the safe evaluation of the signals and the safe contact multiplication of an upstream safety-monitoring module.

The function is defined as the opening of the enabling circuits 13-14, 23-24, 33-34 and 43-44 when the supply voltage A1-A2 is disconnected. The safety-relevant current paths with the output contacts 13-14, 23-24, 33-34 and 43-44 meet the following requirements under observation of a PFH value assessment (also refer to chapter 2.5 "Safety classification"):

- Control category 4 – PL e to DIN EN ISO 13849-1
- Corresponds to SIL 3 to DIN EN 61508-2
- SILCL 3 to DIN EN 62061

To determine the Performance Level (PL) of the entire safety function (e.g. sensor, logic, actuator) to DIN EN ISO 13849-1, an analysis of all relevant components is required.

### 2.4 Technical data

#### General data:

Standards: IEC/EN 60204-1, EN 60947-5-1;  
EN ISO 13849-1, IEC 61508

Climate resistance: EN 60068-2-78

Mounting: Snaps onto standard DIN rail to EN 60715

Terminal designations: EN 60947-1

Material of the housings: Plastic, glass-fibre reinforced thermoplastic, ventilated

Material of the contacts: AgSnO, self-cleaning, positive drive

Weight: 215 g

Start conditions: Automatic

Feedback circuit (Y/N): yes

Pull-in delay: typ. 30 / max. 45 ms

Drop-out delay: typ. 25 / max. 35 ms

#### Mechanical data:

Connection type: refer to 2.1 Ordering code

Cable section: refer to 2.1 Ordering code

Connecting cable: rigid or flexible

Tightening torque for the terminals: 0.6 Nm

With removable terminals (Y/N): yes

Mechanical life: 10 million operations

Electrical life: Derating curve available on request

Resistance to shock: 10 g / 11 ms

Resistance to vibrations to EN 60068-2-6: 10 ... 55 Hz, amplitude 0.35 mm

#### Ambient conditions:

Ambient temperature: –25 °C ... +45 °C

Storage and transport temperature: –40 °C ... +85 °C

Protection class: Enclosure: IP40

Terminals: IP20

Clearance: IP54

Air clearances and creepage distances to IEC/EN 60664-1: 4 kV/2 (basic insulation)

EMC rating: to EMC Directive

#### Electrical data:

Contact resistance in new state: max. 100 mΩ

Power consumption: max. 1.0 VA

Rated operating voltage  $U_e$ : 24 VDC –15% / +20%, residual ripple max. 10%,  
24 VAC –15% / +10%

Frequency range: 50 / 60 Hz

Max. fuse rating of the operating voltage: F1: T 1.0 A / 250 V

#### Monitored inputs:

Short-circuit recognition (Y/N): No

Wire breakage detection (Y/N): Yes

Earth leakage detection (Y/N): Yes

Number of NO contacts: 0

Number of NC contacts: 0

Conduction resistance: max. 40 Ω

#### Outputs:

Number of safety contacts: 4

Number of auxiliary contacts: 2

Number of signalling outputs: 0

Switching capacity of the safety contacts: 13-14; 23-24; 33-34; 43-44:  
max. 250 V, 6 A ohmic (inductive in case of appropriate protective wiring);  
min. 10 V / 10 mA

Switching capacity of the auxiliary contacts: 51-52; 61-62:  
24 VDC / 2 A

Fuse rating of the safety contacts: external ( $I_k = 1000$  A)  
to EN 60947-5-1  
8 A quick blow, 6 A slow blow

Fuse rating for the auxiliary contacts: external ( $I_k = 1000$  A)  
to EN 60947-5-1  
Safety fuse 2.5 A quick blow, 2 A slow blow

Utilisation category to IEC/EN 60947-5-1: AC-15: 230 VAC / 6 A  
DC-13: 24 VDC / 6 A

Dimensions H x W x D: SRB402EM: 120 × 22.5 × 121 mm  
SRB402EM/CC: 130 × 22.5 × 121 mm

The data specified in this manual are applicable when the component is operated with rated operating voltage  $U_e \pm 0\%$ .

### 2.5 Safety classification

Standards:	EN ISO 13849-1, IEC 61508, EN 60947-5-1
PL:	up to e
Control category:	up to 4
DC:	99% (high)
CCF:	> 65 points
PFH value:	$\leq 2.0 \times 10^{-8}/h$
SIL:	up to 3
Service life:	20 years

The PFH value of  $2.0 \times 10^{-8}/h$  applies to the combinations of contact load (current through enabling contacts) and number of switching cycles ( $n_{op/y}$ ) mentioned in the table below. At 365 operating days per year and a 24-hours operation, this results in the below-mentioned switching cycle times ( $t_{cycle}$ ) for the relay contacts. Diverging applications upon request.

Contact load	$n_{op/y}$	$t_{cycle}$
20 %	525,600	1.0 min
40 %	210,240	2.5 min
60 %	75,087	7.0 min
80 %	30,918	17.0 min
100 %	12,223	43.0 min

## 3. Mounting

### 3.1 General mounting instructions

Mounting: snaps onto standard DIN rails to EN 60715.

Snap the bottom of the enclosure slightly tilted forwards in the DIN rail and push up until it latches in position.

### 3.2 Dimensions

All measurements in mm.

Device dimensions (H/W/D):

SRB402EM: 120 × 22.5 × 121 mm

SRB402EM/CC: 130 × 22.5 × 121 mm

## 4. Electrical connection

### 4.1 General information for electrical connection



As far as the electrical safety is concerned, the protection against unintentional contact of the connected and therefore electrically interconnected apparatus and the insulation of the feed cables must be designed for the highest voltage, which can occur in the device.



The electrical connection may only be carried out by authorised personnel in a de-energised condition.

**Wiring examples: see appendix**

## 5. Operating principle and settings

### 5.1 LED functions

- K1/K2: status channels 1 and 2

### 5.2 Description of the terminals

Voltages:	A1	+24 VDC/24 VAC
	A2	0 VDC/24 VAC
Outputs:	13-14	First safety enabling circuit
	23-24	Second safety enabling circuit
	33-34	Third safety enabling circuit
	43-44	Fourth safety enabling circuit
	51-52	Auxiliary NC contact as signalling contact
	61-62	Auxiliary NC contact as signalling contact
Start:	X1-X2	Feedback circuit



Signalling outputs must not be used in safety circuits.




Fig. 1

### 6. Set-up and maintenance

#### 6.1 Functional testing

The function of the output expander module must be tested. The following conditions must be previously checked and met:

1. Correct fixing
2. Check the integrity of the cable entry and connections
3. Check the output expander module's enclosure for damage.

#### 6.2 Maintenance

A regular visual inspection and functional test, including the following steps, is recommended:

1. Check the correct fixing of the output expander module
2. Check the cable for damages
3. Check electrical function



The device has to be integrated into the periodic check-ups according to the Ordinance on Industrial Safety and Health, however at least 1 × year.

**Damaged or defective components must be replaced.**

### 7. Disassembly and disposal

#### 7.1 Disassembly

The output expander module must be disassembled in the de-energised condition only. Push up the bottom of the enclosure and hang out slightly tilted forwards.

#### 7.2 Disposal

The output expander module must be disposed of in an appropriate manner in accordance with the national prescriptions and legislations.

### 8. Appendix

#### 8.1 Wiring example

**Single-channel control at terminal A1 of the SRB402EM expander module through a safety release of the basic module (Fig. 1)**

- The terminals X1 and X2 of the expander module must be connected to the feedback circuit or the single-switch circuit of the basic module.



**Safety notice:** the expander module must be wired in accordance with the wiring example. **The safety function is only realised in conjunction with the basic device.**

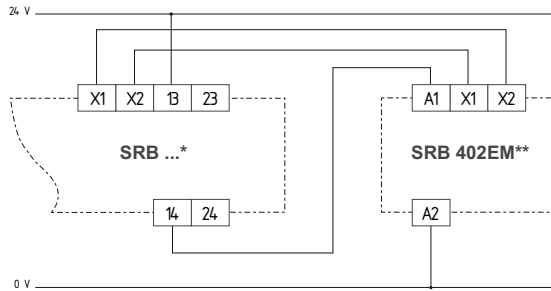


Fig. 2 \* = basic module; \*\* = expander module



**Example!** The terminal designation of the basic module can deviate depending on the used type, please also observe the description of the basic module!

#### Internal wiring diagram

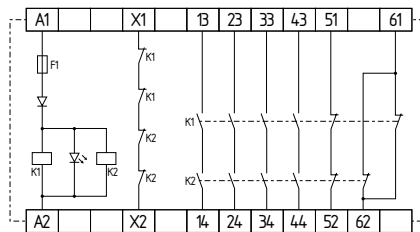


Fig. 3

9. EU Declaration of conformity

EU Declaration of conformity



Original  
K.A. Schmersal GmbH & Co. KG  
Möddinghofe 30  
42279 Wuppertal  
Germany  
Internet: www.schmersal.com

We hereby certify that the hereafter described components both in their basic design and construction conform to the applicable European Directives.

**Name of the component:** SRB402EM,  
SRB402EM/CC

**Description of the component:** Contact expander module  
This device has no internal logic and must only be used as output expander in conjunction with a basic component, which is suitable for the application.

<b>Relevant Directives:</b>		Valid up to	Valid as of
		April 19, 2016	April 20, 2016
	Low Voltage Directive	2006/95/EC	2014/35/EU
	EMC-Directive	2004/108/EC	2014/30/EU
	RoHS-Directive	2011/65/EU	2011/65/EU

**Applied standards:** EN 60947-5-1:2004 + AC:2005 + A1:2009

**Place and date of issue:** Wuppertal, April 13, 2016

Authorised signature  
**Philip Schmersal**  
Managing Director

SRB402EM-E-EN



The currently valid declaration of conformity can be downloaded from the internet at [www.schmersal.net](http://www.schmersal.net).



**K. A. Schmersal GmbH & Co. KG**  
**Industrielle Sicherheitssysteme**  
Möddinghofe 30, D - 42279 Wuppertal  
Postfach 24 02 63, D - 42232 Wuppertal

Phone: +49 - (0)2 02 - 64 74 - 0  
Telefax: +49 - (0)2 02 - 64 74 - 1 00  
E-Mail: [info@schmersal.com](mailto:info@schmersal.com)  
Internet: <http://www.schmersal.com>

## X-ON Electronics

Largest Supplier of Electrical and Electronic Components

*Click to view similar products for [Emergency Stop Switches / E-Stop Switches](#) category:*

*Click to view products by [Schmersal](#) manufacturer:*

Other Similar products are found below :

[84-5021.2B40](#) [84-6830.0020](#) [A01ESSP8](#) [A22EL-M-24A-11B](#) [AVN302N-R](#) [A165E-S-01\(STOP\)](#) [AYLD2212602SN-R-TK962](#)  
[AVLD39911N-R-24V](#) [A22Z-EG22](#) [A165E-SY](#) [3100.0110Y](#) [3050.1302Y](#) [3SE2243-0XX40](#) [3SK1111-2AB30](#) [3SK1211-1BB40](#) [44-710](#) [84-](#)  
[6841.2B20](#) [84-6830.0040](#) [H3141AAKAA](#) [A165E-R-24D-01](#) [E3102AAAAB](#) [A22E-M-03](#) [ZA2BV05](#) [A22EL-M-T2-01](#) [951FY000-WO](#)  
[ER6022-022N](#) [952+2000-00](#) [ES3S51653](#) [601+0000-OP](#) [E3101AAAAB](#) [84-5130.0040](#) [CS AR-05V024](#) [CS AR-22V024](#) [DS AE1VA](#) [DS](#)  
[KB2A](#) [DS KB3A](#) [HE2G-21SHE-L-K](#) [HE6B-M211Y](#) [774191](#) [774316](#) [777760](#) [R1.100.0129.0 SMA0129- NO/NO](#) [R1.188.0640.0 SNV](#)  
[4063KL-A](#) [R1.188.1810.0 SNA 4043K-A](#) [R1.188.1840.0 SNA 4043K-A](#) [SR BD40ALK-B02F](#) [AVLW39911D-R-120V](#) [AYD311NUG](#)  
[AVLD32211DNUR](#) [84-5040.0020.0049](#)