

hour clock Contents EL11 (24 hour) or EL17 (7 day) Panel mount bezel Tamper proof cover Surface mount stand offs (length 10mm)

Figure 1

Override button

conjunction with th

programme button

and times/days for

ON periods

to programme clock

CHANGE

also used in

Panel mount bolts


Self-tapping screws (No. 4 x 5/8 in) for panel mount bolts Self-tapping screws (No.6 x 3/8 in) for attaching bezel to EL11/17

# General

The EL11 (24 hour) or EL17 (7 day) is primarily a panel mounted timeswitch rated at 240V, 16A resistive at T40. It can also be surface mounted within cubicles if required

The contacts are single pole change over and are fully voltage free. The front of the unit is shown in figure 1. The rear of the unit showing wiring connections and the internal circuit is shown in figure 2.

Connections are made to the EL11/17 by 1/4 in receptacles. The unit can be made tamper proof by wiring the cover supplied in place which still leaves the display visible.



Programme

Programme

Programme

Programme

Setting clock	····→ Programme 3 ON
Programme 1 ON	<ul> <li>Programme 3 OFF</li> </ul>
rogramme 1 OFF	Programme 4 ON
Programme 2 ON	Programme 4 OFF
rogramme 2 OFF ······	<ul> <li>Operating Mode</li> </ul>

Note: Button pauses greater than 1 minute during programming will result in

Hour Setting - Press the <Change> button to advance the hour setting. Note: For rapid hour selections press

Minute Setting - Press the <Program> button once to select the minutes - display shows clock symbol and minute digits flashing. Press the <Change> button to advance the minutes setting. Note: For rapid minute selection press and hold down <Change> button. (Note: 16 hrs shown as example of hrs set)

Press < Program> button once - clock is now set and display shows ready for the first ON programme time

3. To Set Programme ON/OFF Times

Press <Change> button to advance the hour setting.

Press <Program> button once to select minute time display shows minute digits and ON flashing. Press <Change> button to advance minute setting. (Note: 16 hrs shown as example of hours set).







- Now set the hrs and minutes as before.
- Repeat steps i to iv to set the remainder of the 3 ON/OFF times as required. Note: Any unused ON/OFF programme should be skipped until the display shows normal operating mode. Do not programme '0's into unused

IMPORTANT After setting a clock time which falls within a programmed ON period, the unit will not switch ON. Use the override facility to switch unit ON. After this the unit will operate normally to the programmes set.

### 4. Programme Review

To fast review the set programmes or for quick exit to normal operating mode press and hold the <Program> button.

# 5. Initiating Programme Mode

This can be initiated any time during the normal operating mode. Press <Program> button and the Clock symbol, hrs and minutes symbols on the display will flash - this is review mode. If any change to programmes is required press <Change> button to initiate programme mode and then follow steps 2 and 3.

## 6. Cancelling Programmes

Any ON/OFF programme can be cancelled by clearing its ON and OFF time. Follow step 5 and when into the ON or OFF programme to be cancelled press

the <Change> button until the hour digits show --: then press the <Program> button to clear the programme. The display will show the hour and minute digits and ON or OFF flashing.



# Self Cancelling Override

To change the output status from ON to OFF or vice versa during normal operation press the <Change> button. The output status will change and indicate override is in operation by flashing.






1 2 3 4

< I N



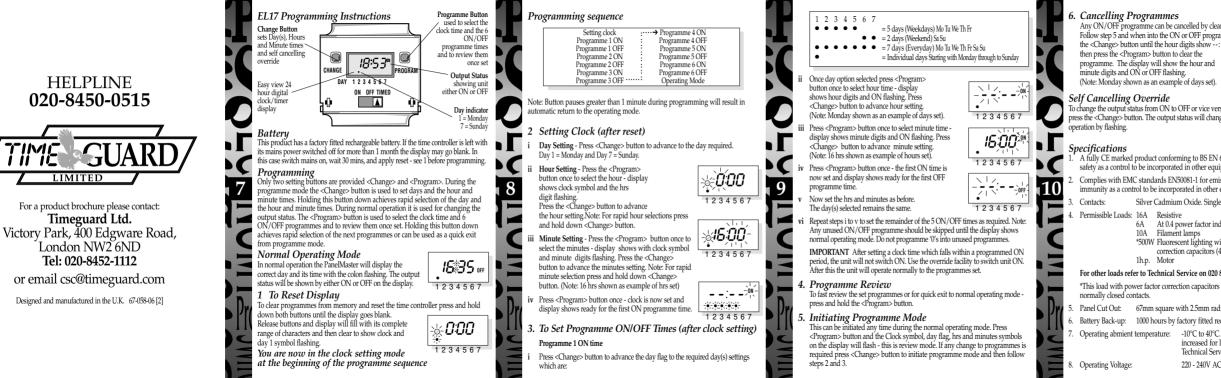

Any ON/OFF programme can be cancelled by clearing its ON and OFF time. Follow step 5 and when into the ON or OFF programme to be cancelled press



To change the output status from ON to OFF or vice versa during normal operation press the <Change> button. The output status will change and indicate override is in

- A fully CE marked product conforming to BS EN 60730-2-7 for function and safety as a control to be incorporated in other equipment.
- Complies with EMC standards EN50081-1 for emission and EN50082-1 for immunity as a control to be incorporated in other equipment.
  - Silver Cadmium Oxide. Single pole change over.


    - At 0.4 power factor inductive
  - 10A Filament lamps
  - \*500W Fluorescent lighting with or without power factor correction capacitors (4uF per 65W tube)

### For other loads refer to Technical Service on 020 8450 0515

\*This load with power factor correction capacitors is not recommended for

- Panel Cut Out: 67mm square with 2.5mm radius corners.
- Batterv Back-up: 1000 hours by factory fitted rechargeable battery.
- Operating abmient temperature: -10°C to 40°C. Upper limit can be increased for loads less than 16A - refer to Technical Service.

220 - 240V AC 50Hz

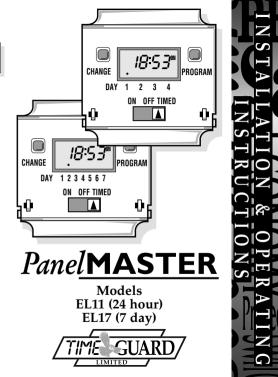

# **X-ON Electronics**

Largest Supplier of Electrical and Electronic Components

Click to view similar products for timeguard manufacturer:

Other Similar products are found below :

EMU17 ELU56 FST24 RCD08MPV